

Fig. 1

09715354 111700

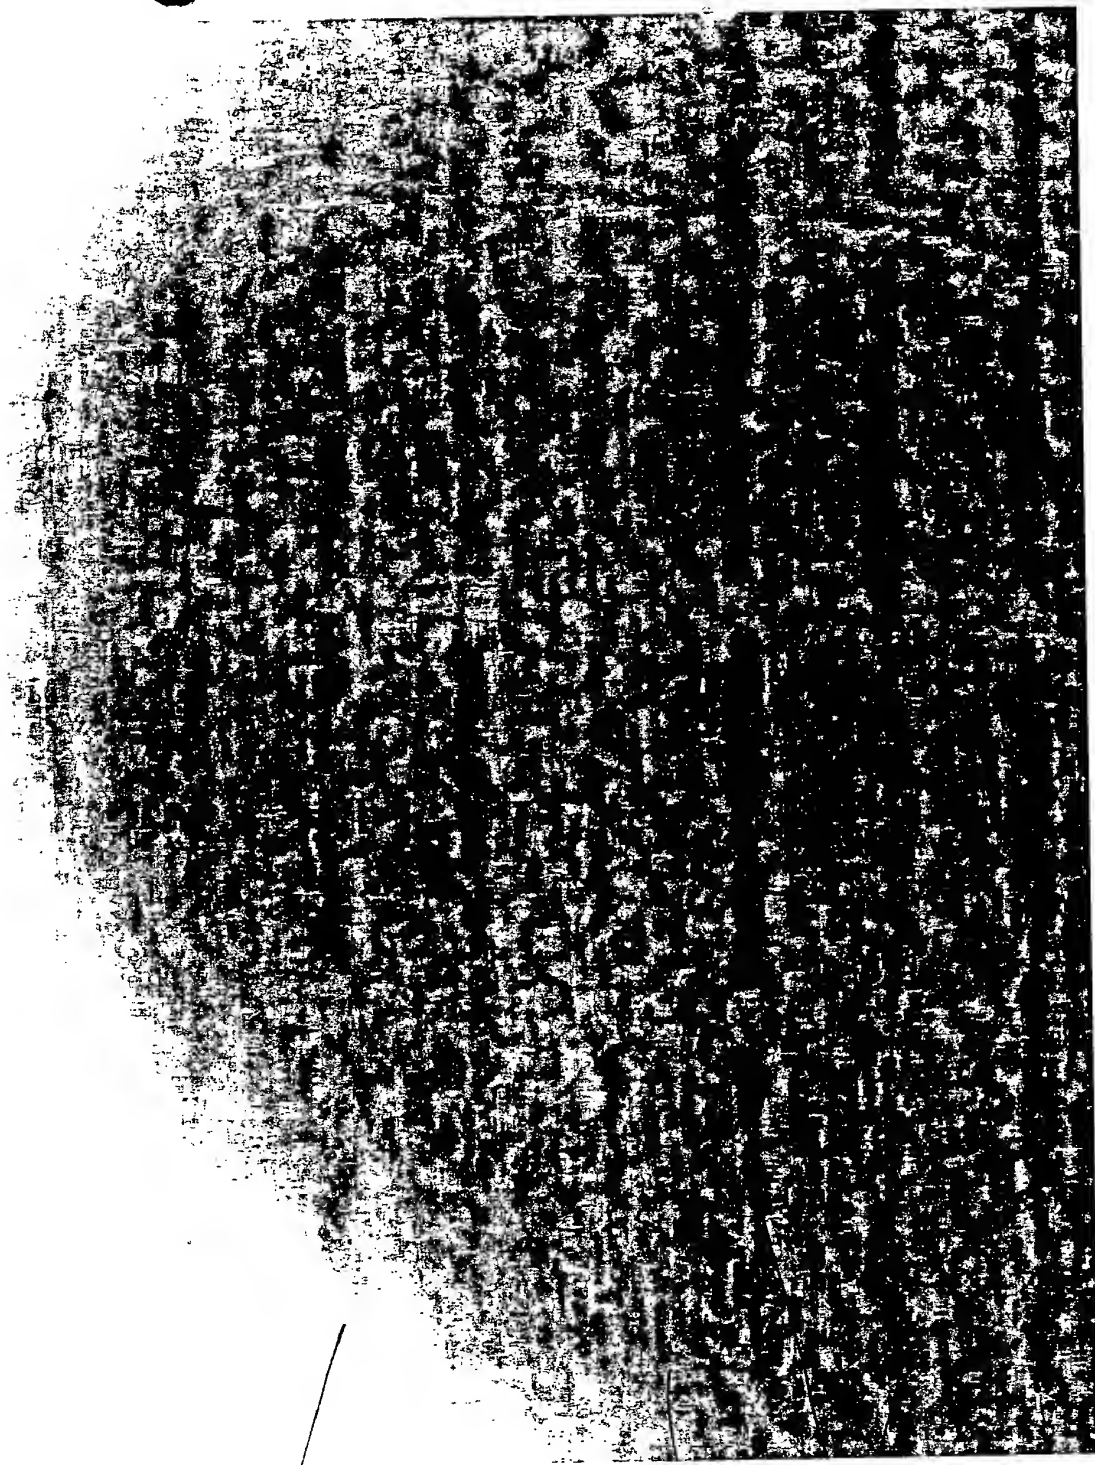


Fig. 2

09745354-11700




48

42


44

09715354.111700

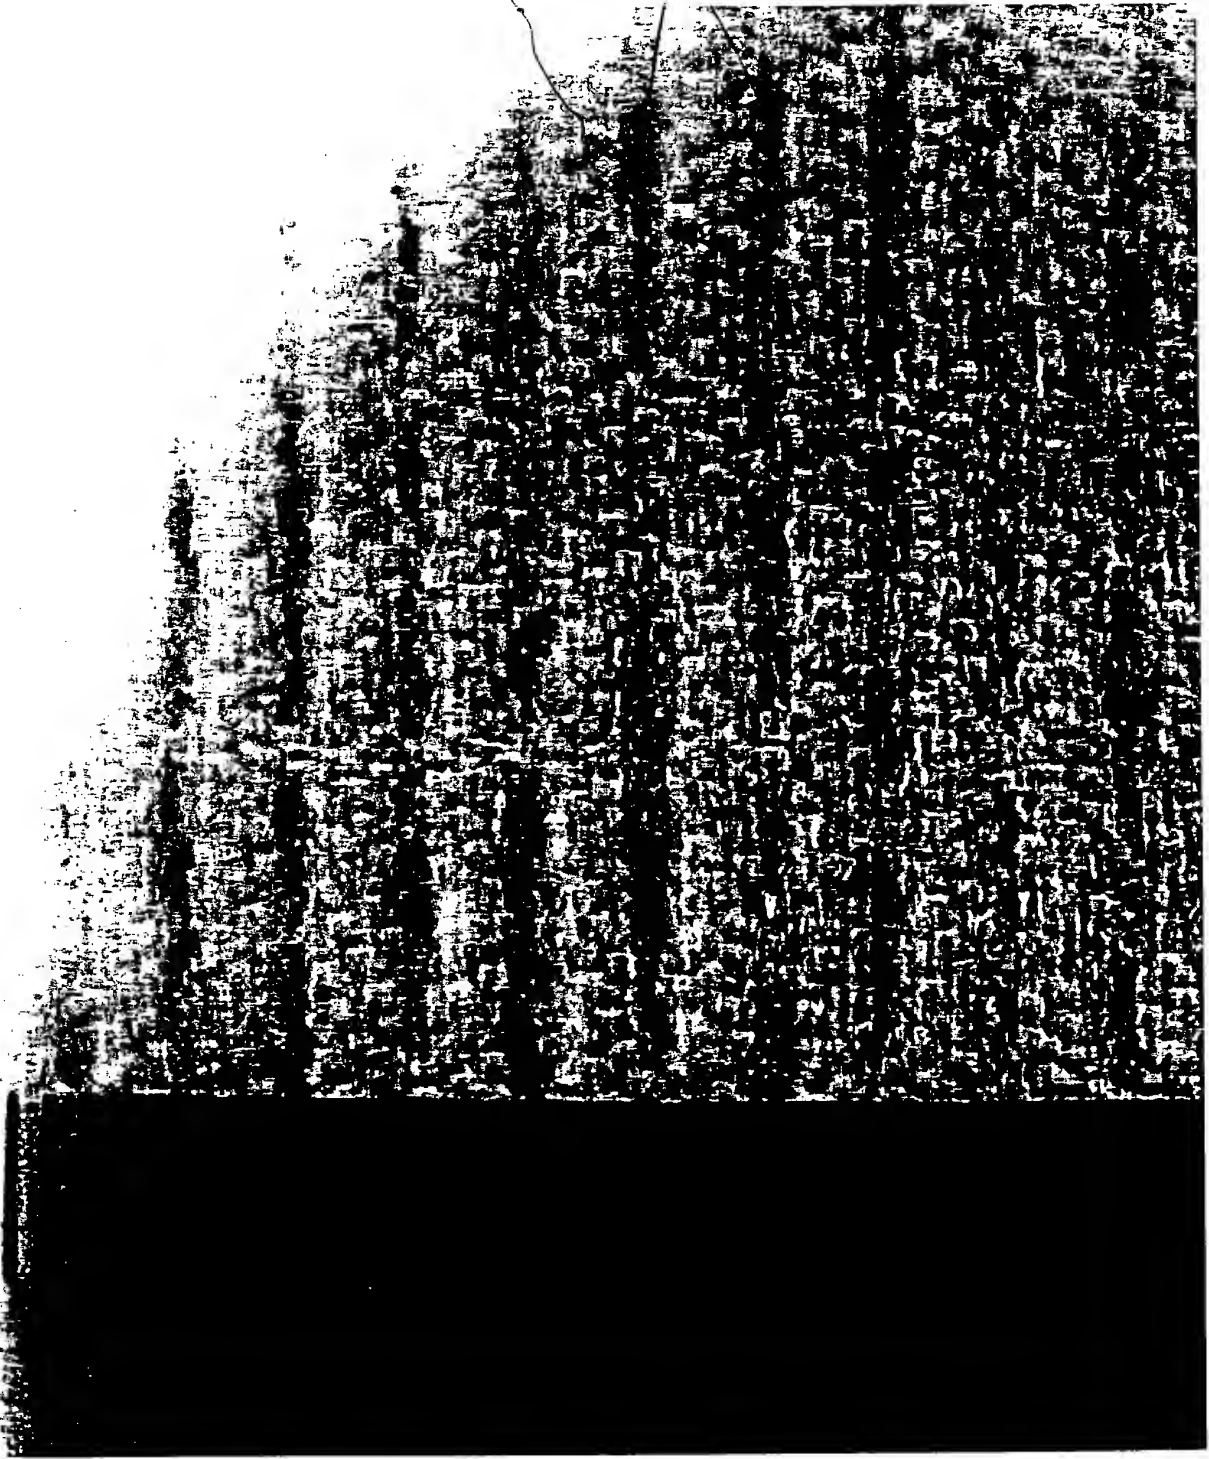

111

00715354-111700

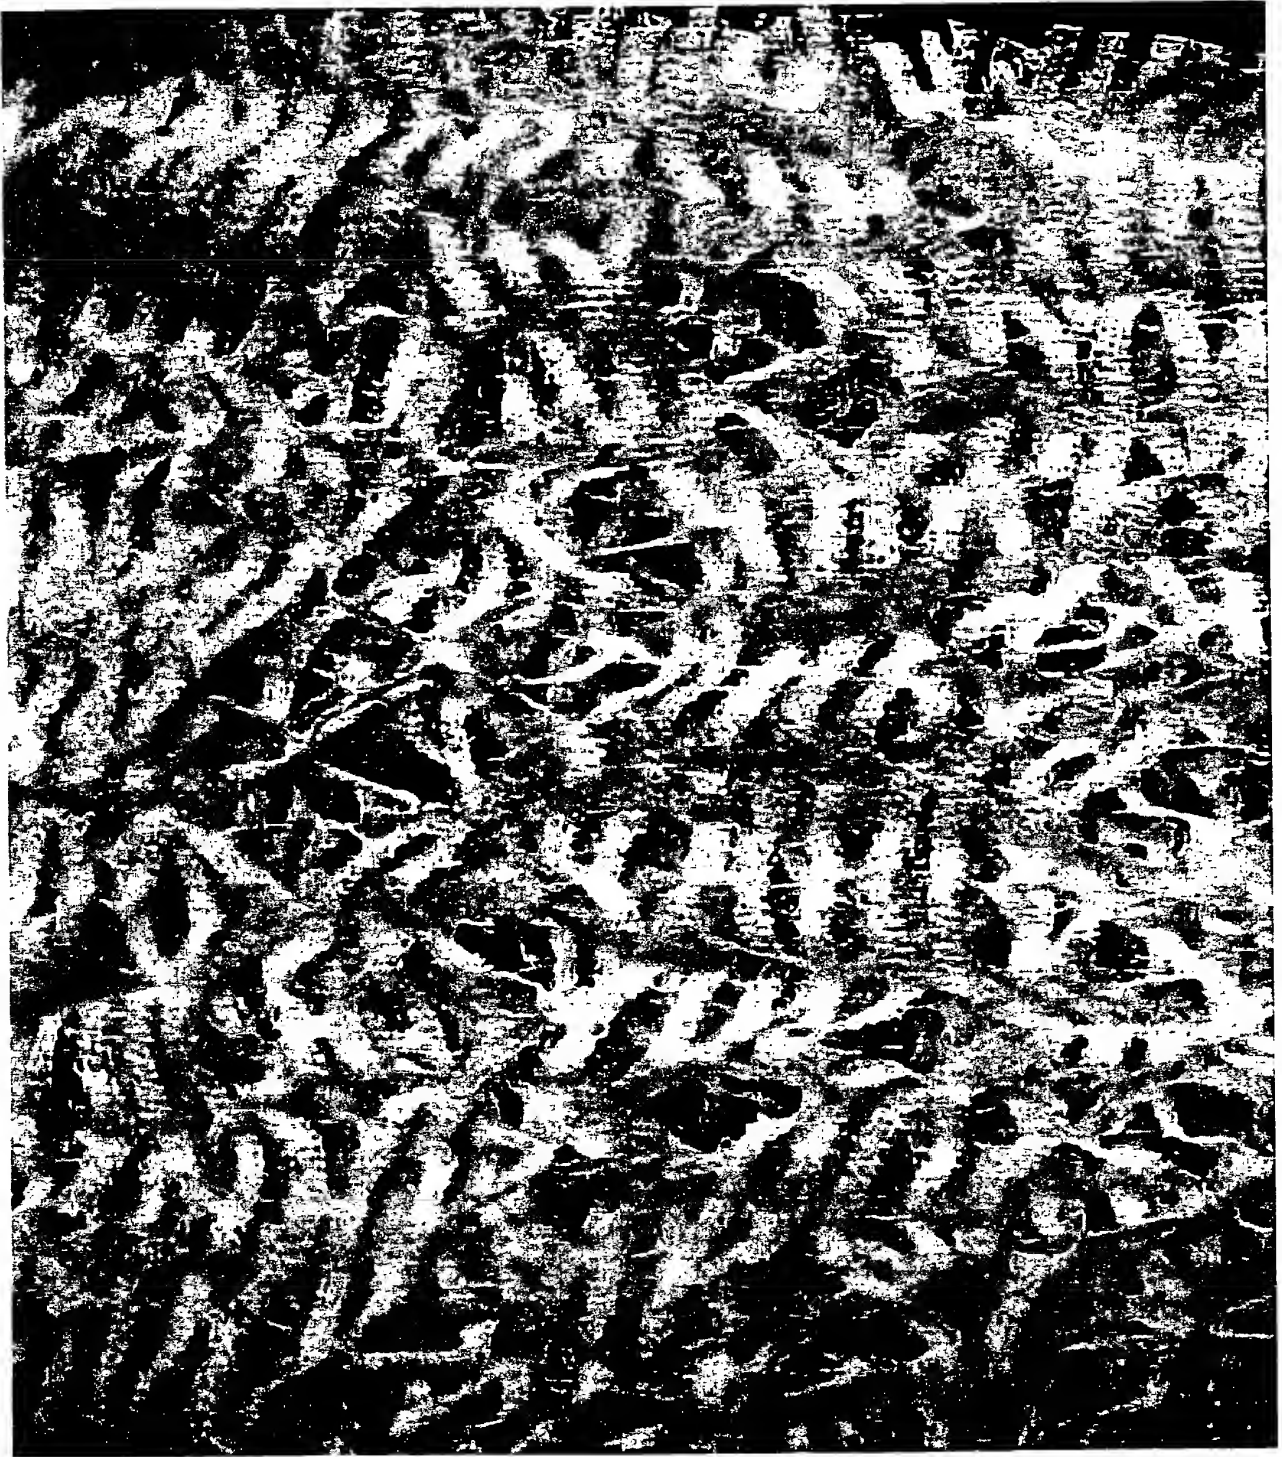

35

42

48

44

0074554-44700




40


00745354 11700



09715354.111700

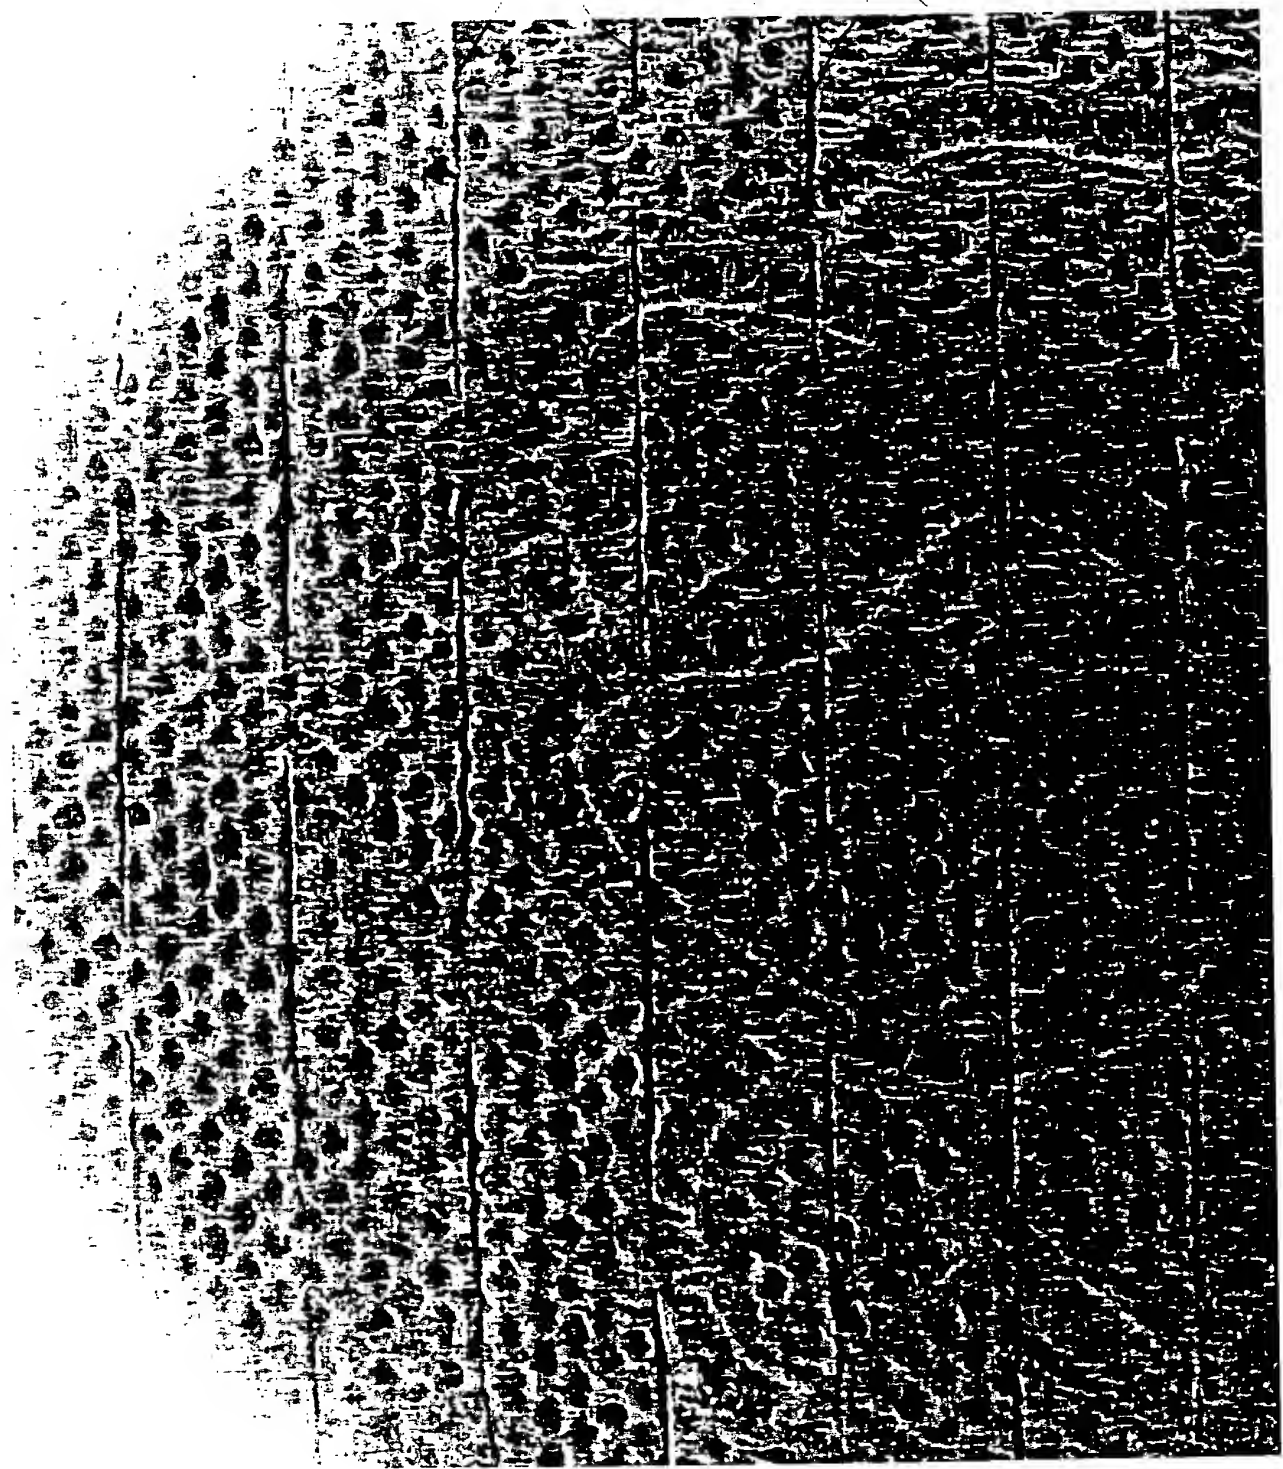

00477 455760

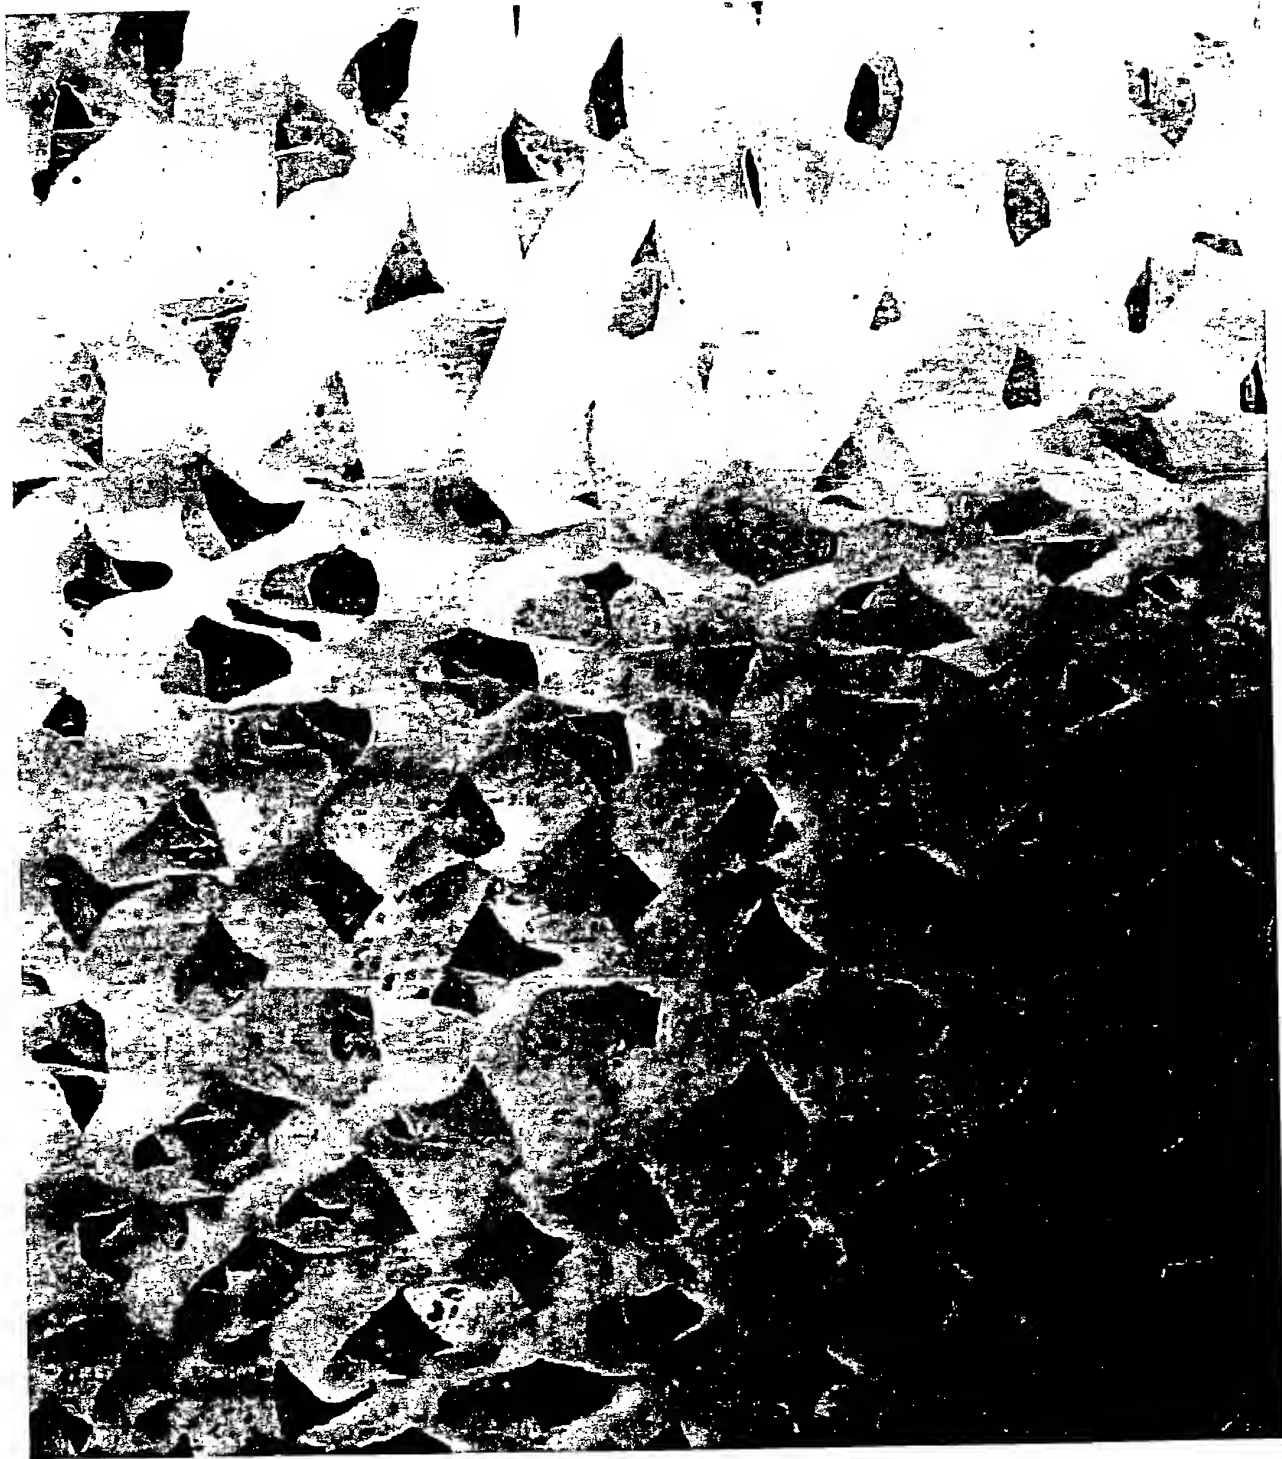


48

42

44

00715354.44700

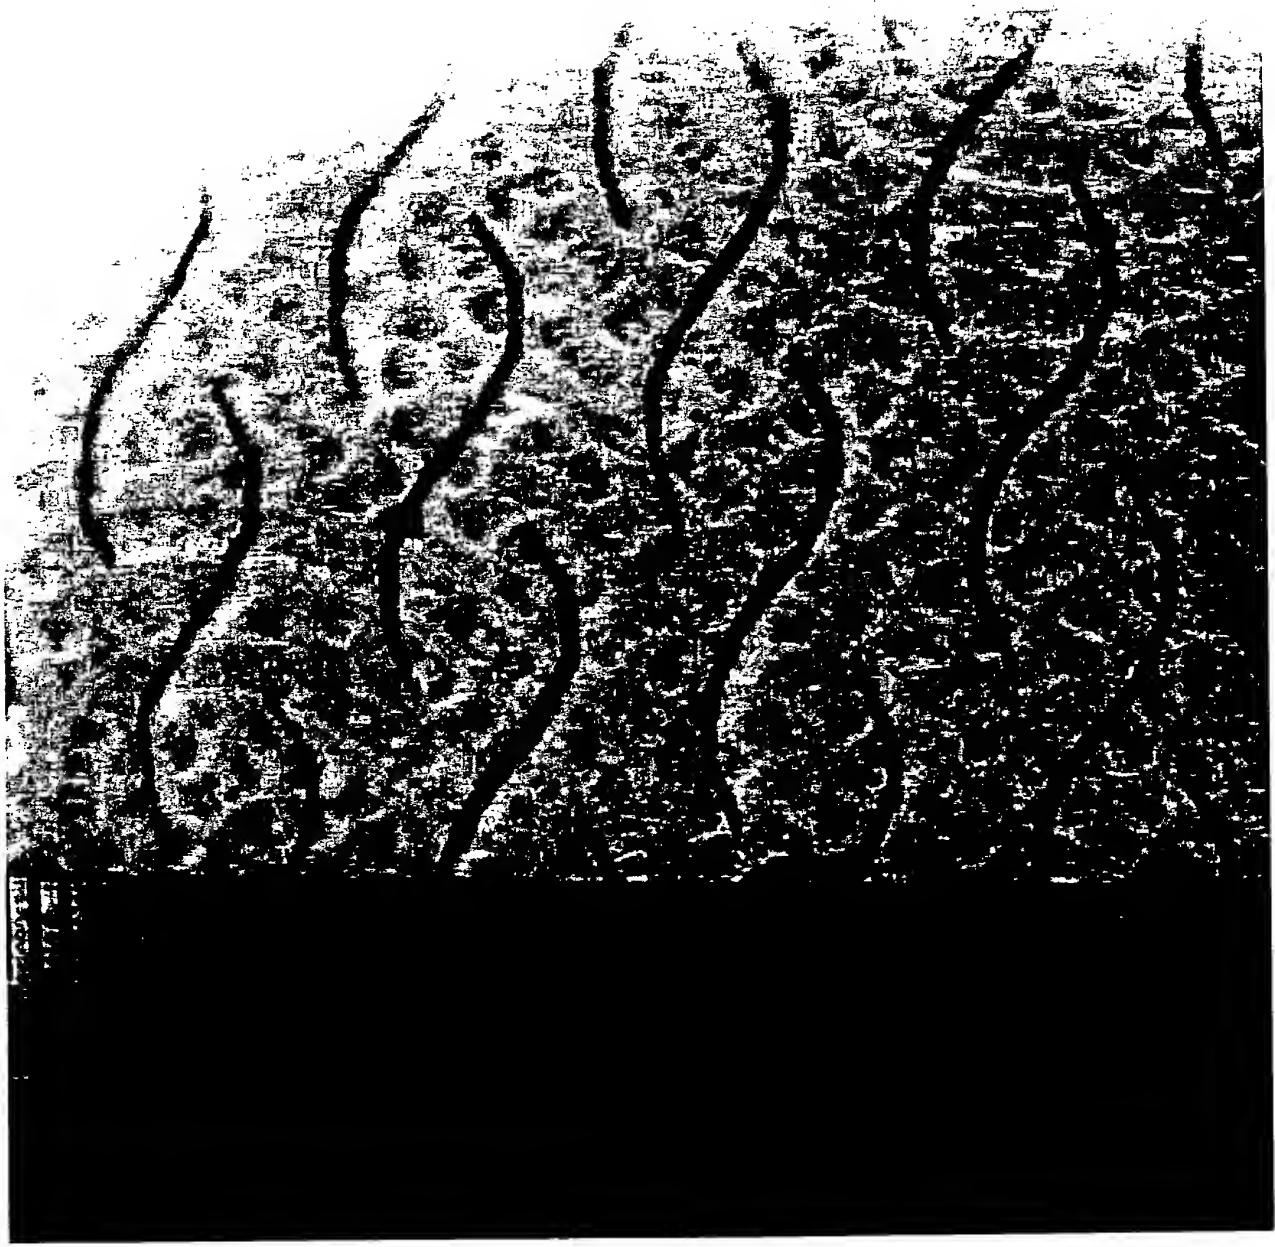

↑ Centimeter Ruler

10 -

09745354.111700

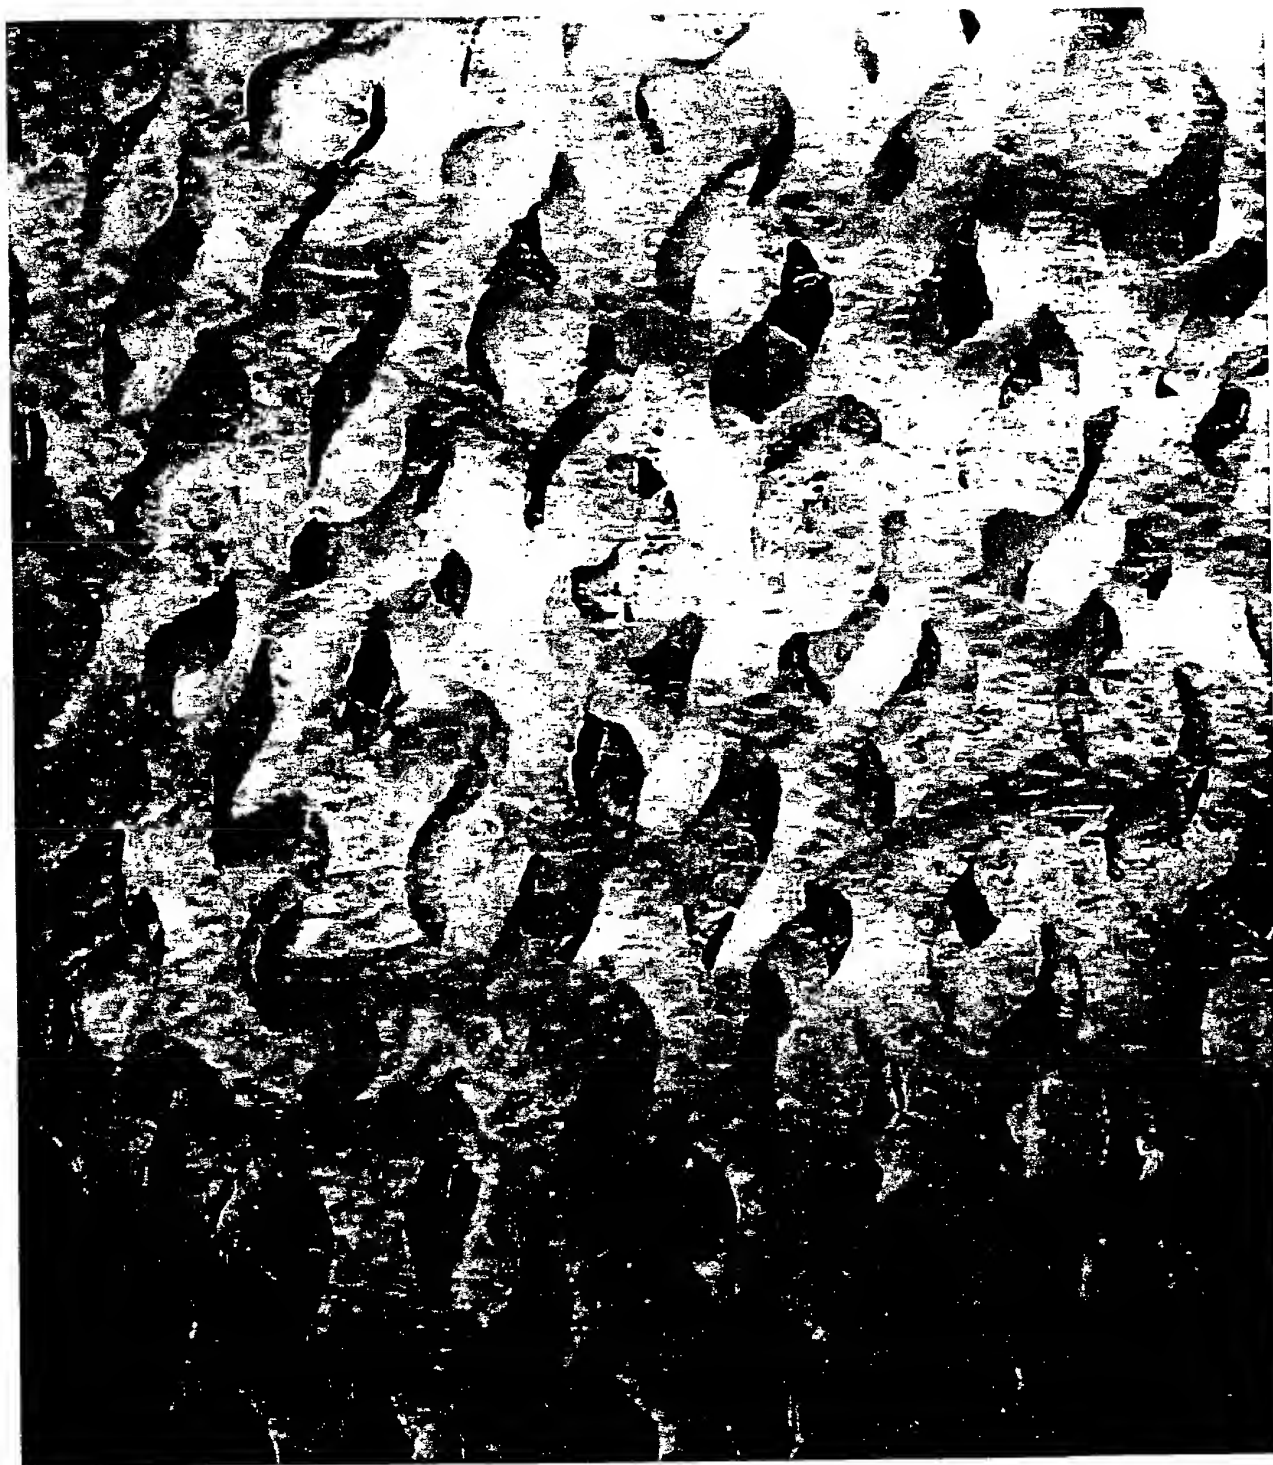



Fig. 11

42

44

48

00715354.11700

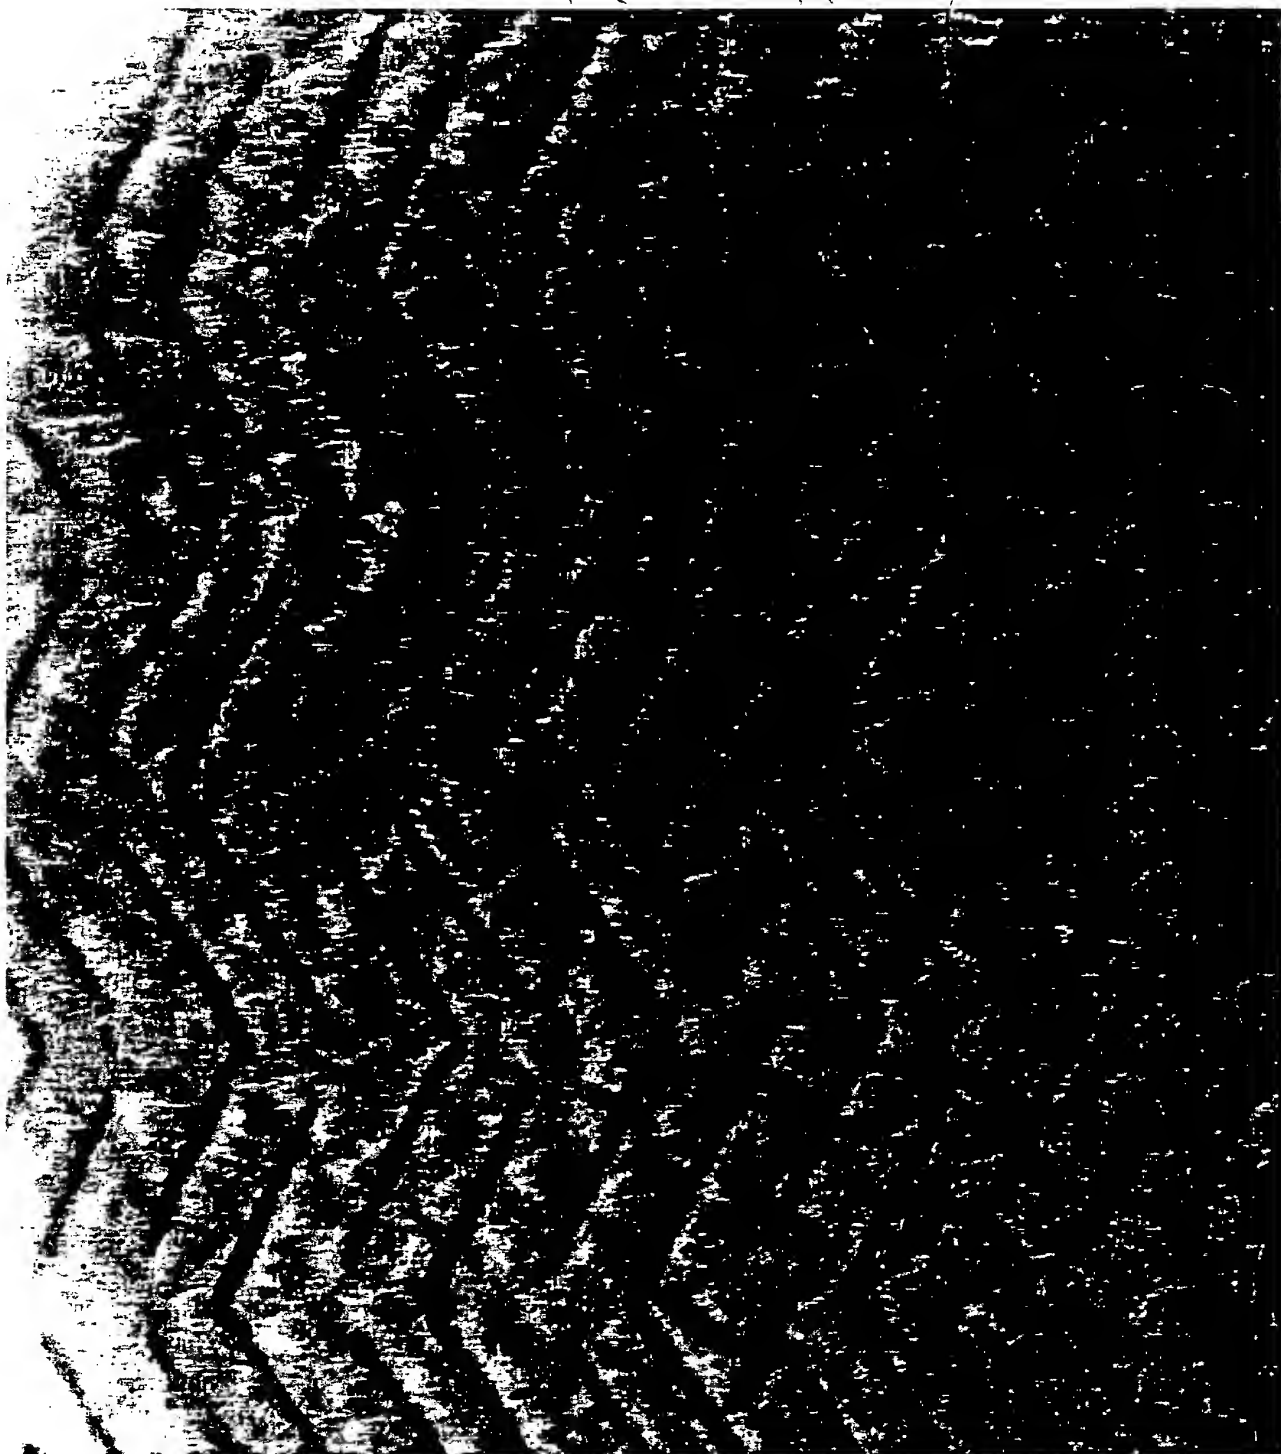

40

Fig. 12

09715354 111700



Figure 13A Example 1 with Prior Art

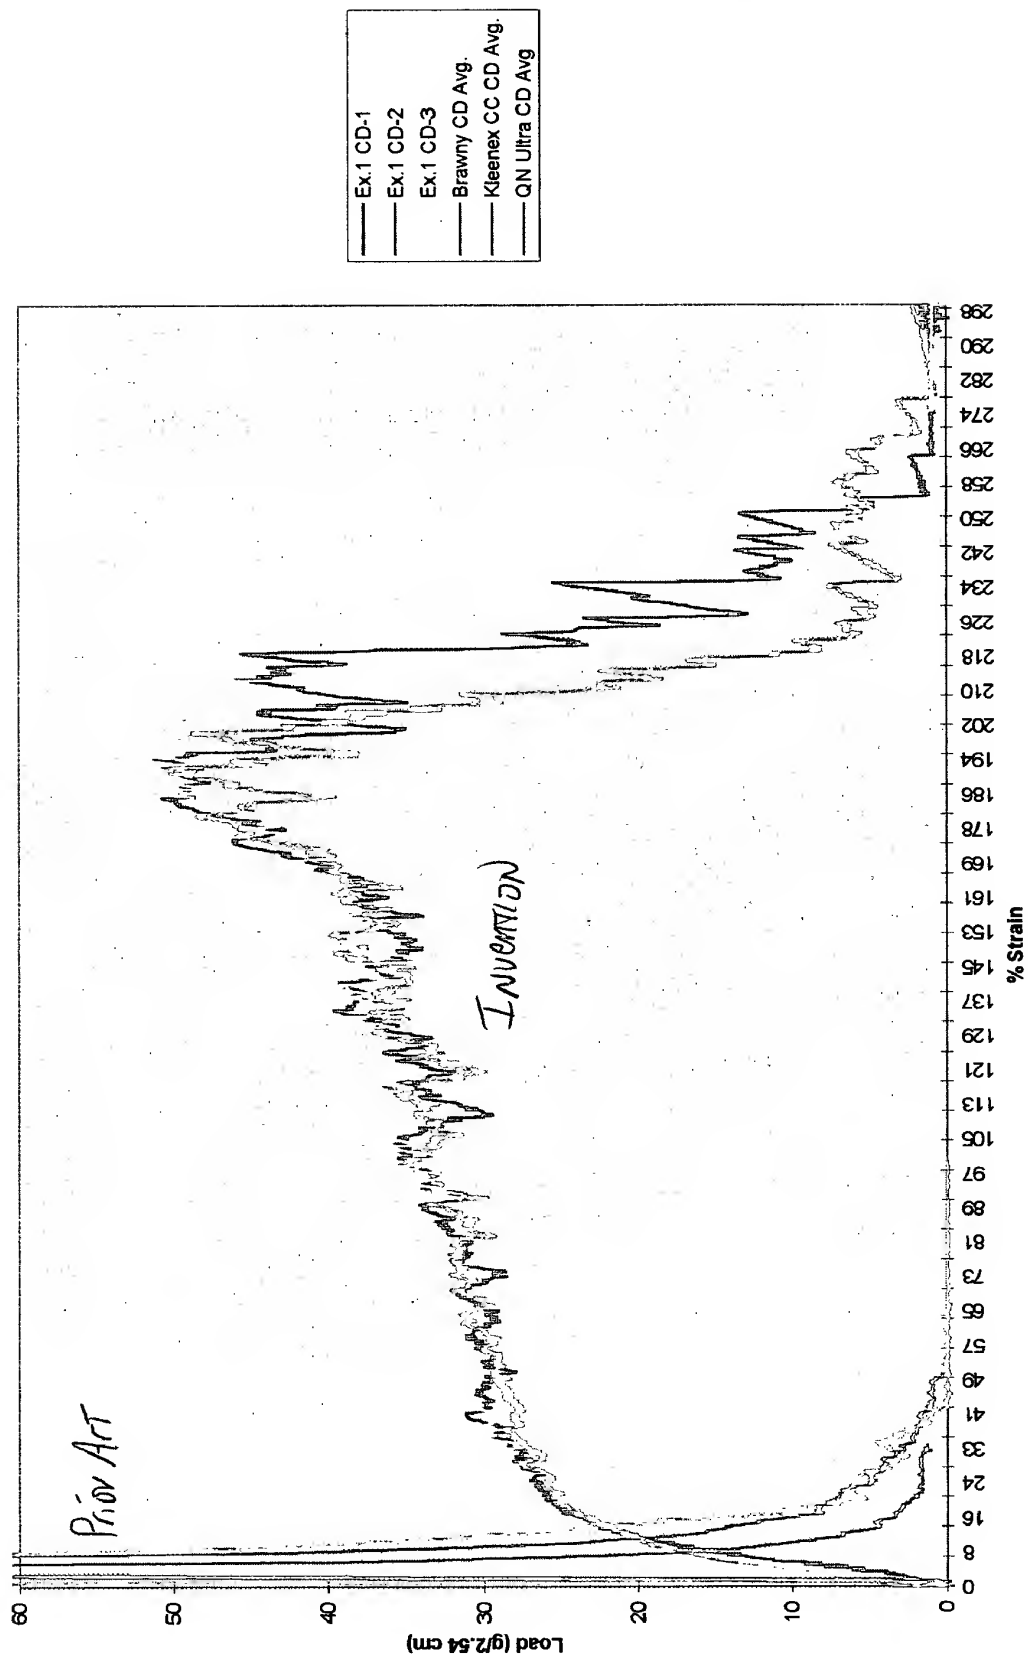


Figure 14. Example 2



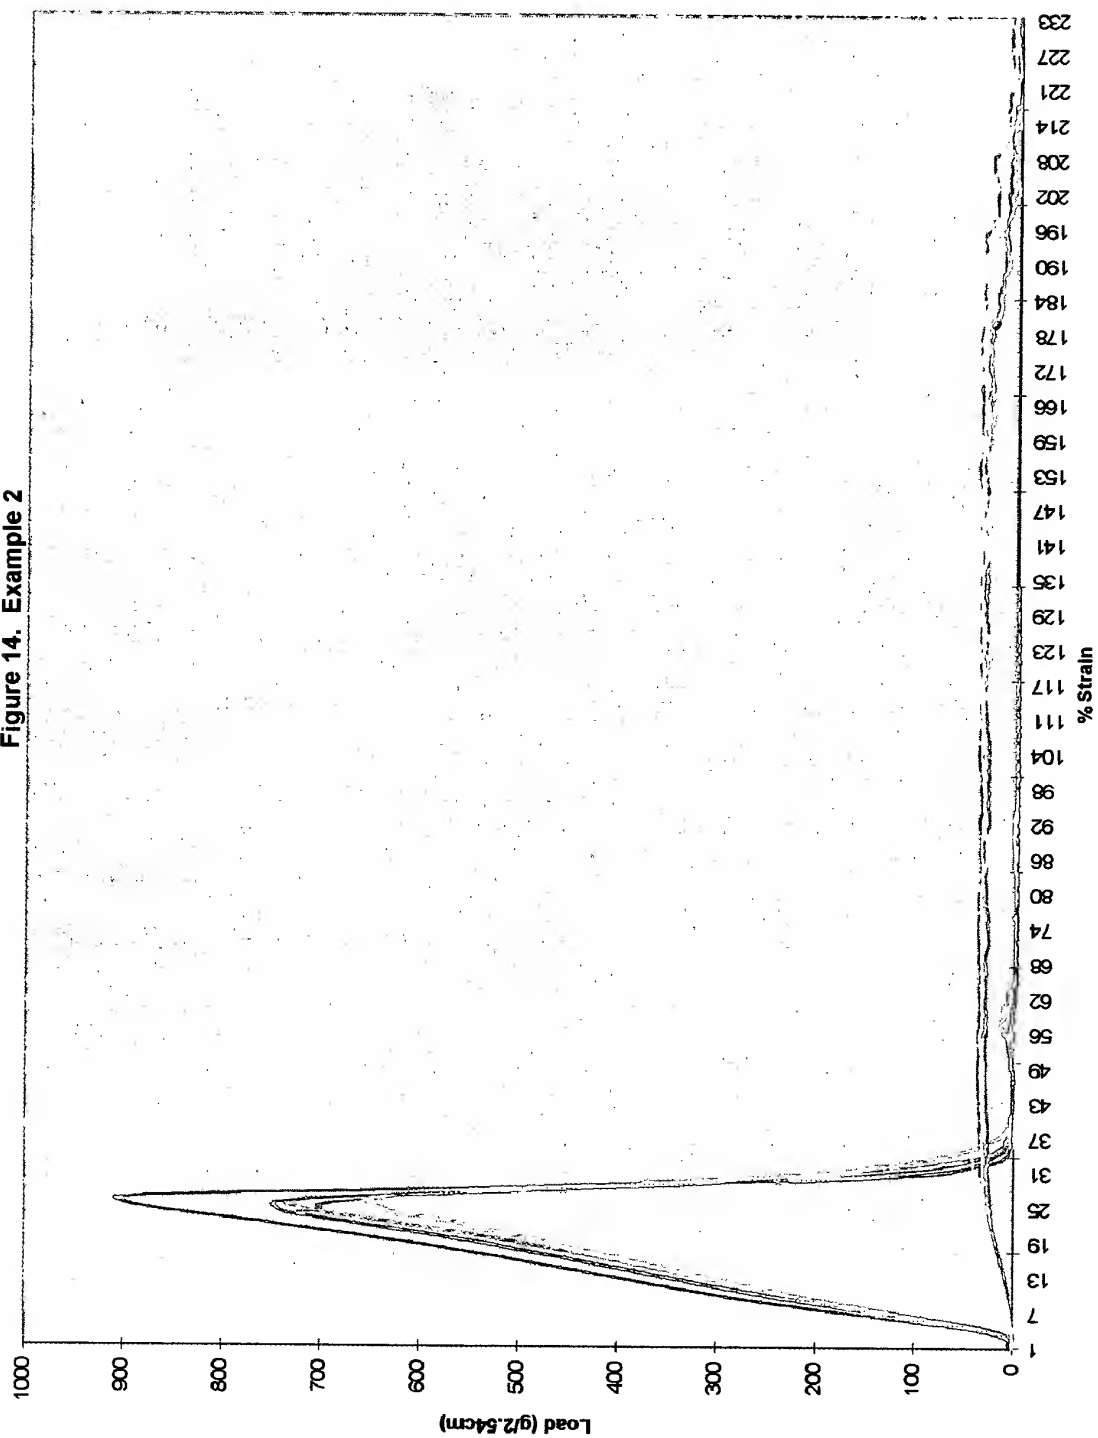


Figure 15. Example 3

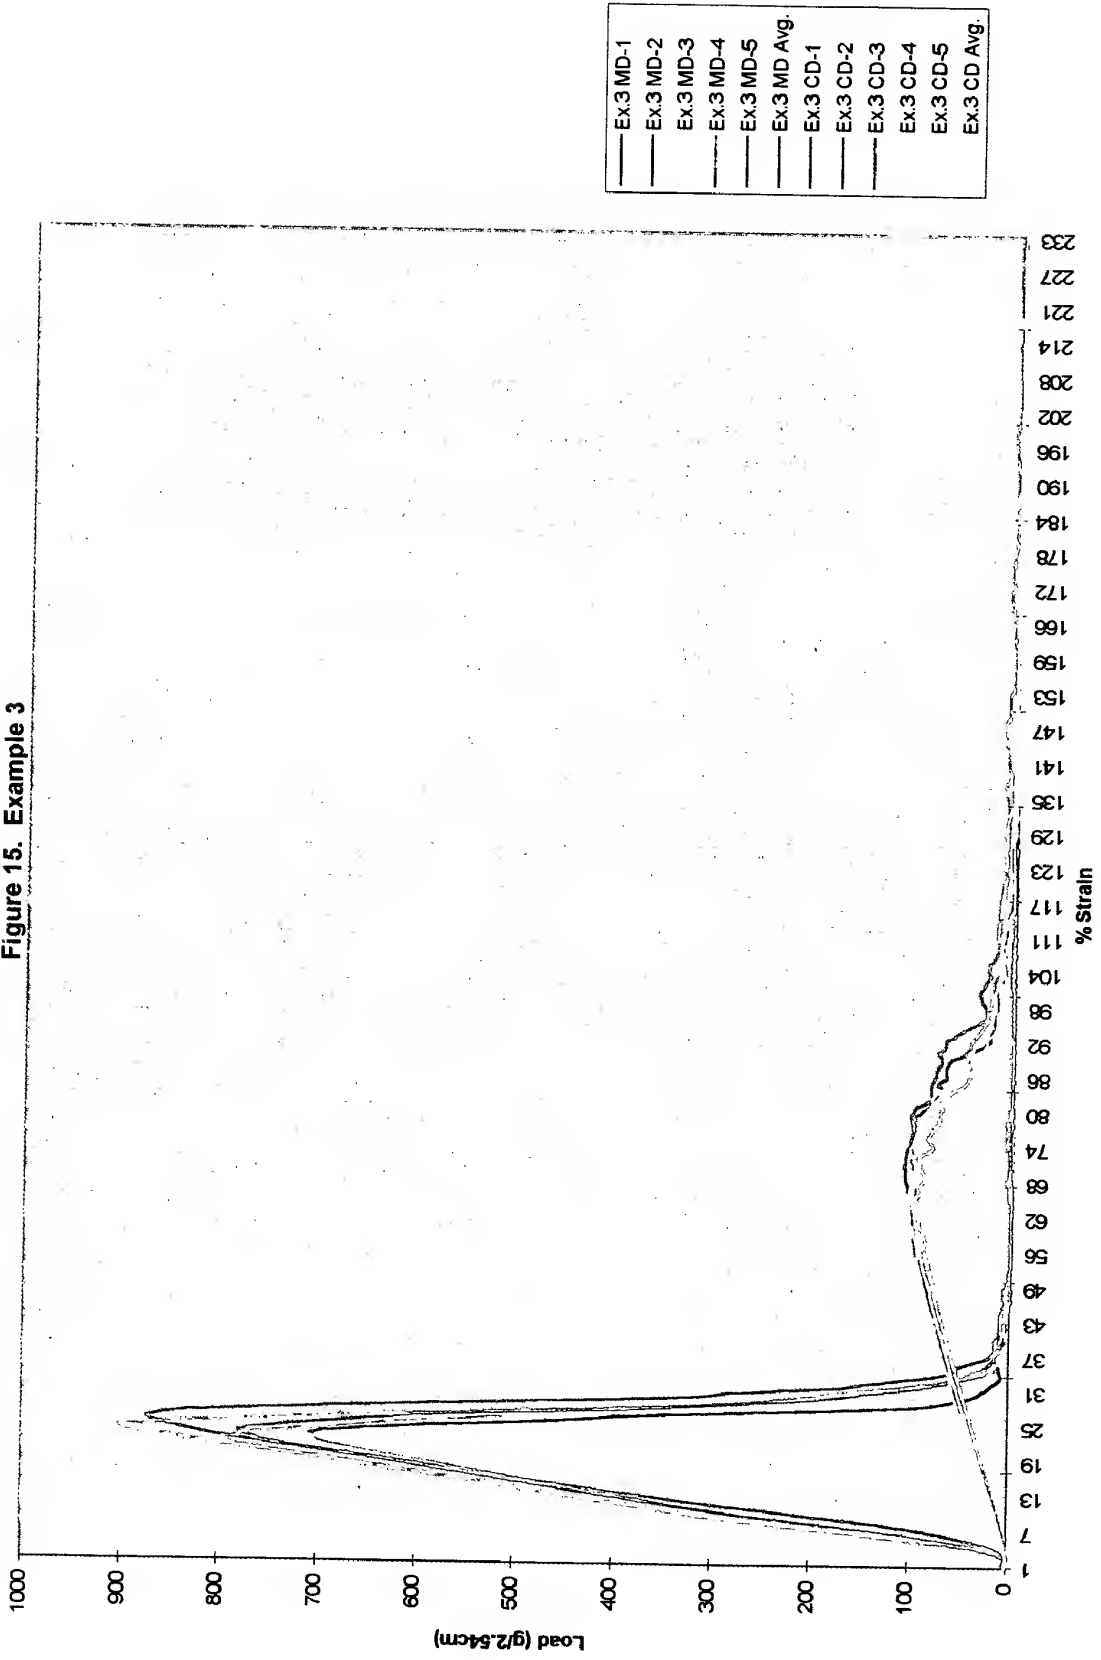

002FF" HRESF.260

Figure 16. Example 4

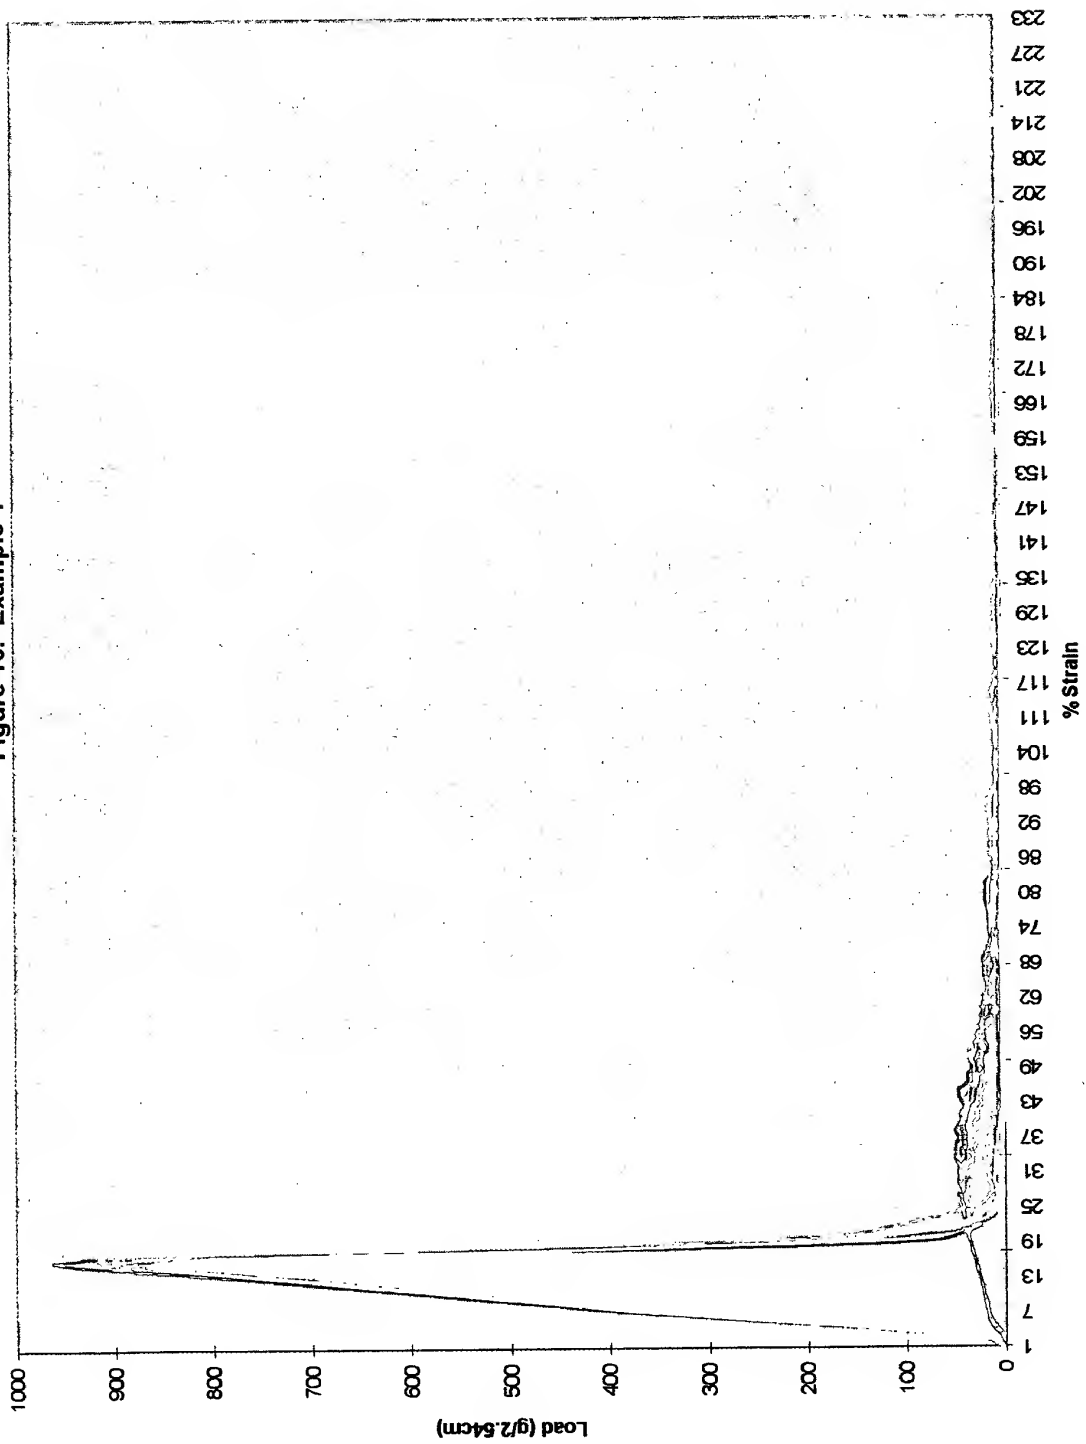

- Ex 4 CD-1
- Ex 4 CD-2
- Ex 4 CD-3
- Ex 4 CD-4
- Ex 4 CD-5
- Ex 4 CD Avg.
- Ex 4 MD-1
- Ex 4 MD-2
- Ex 4 MD-3
- Ex 4 MD-4
- Ex 4 MD-5
- Ex 4 MD Avg.

Figure 17. Example 5


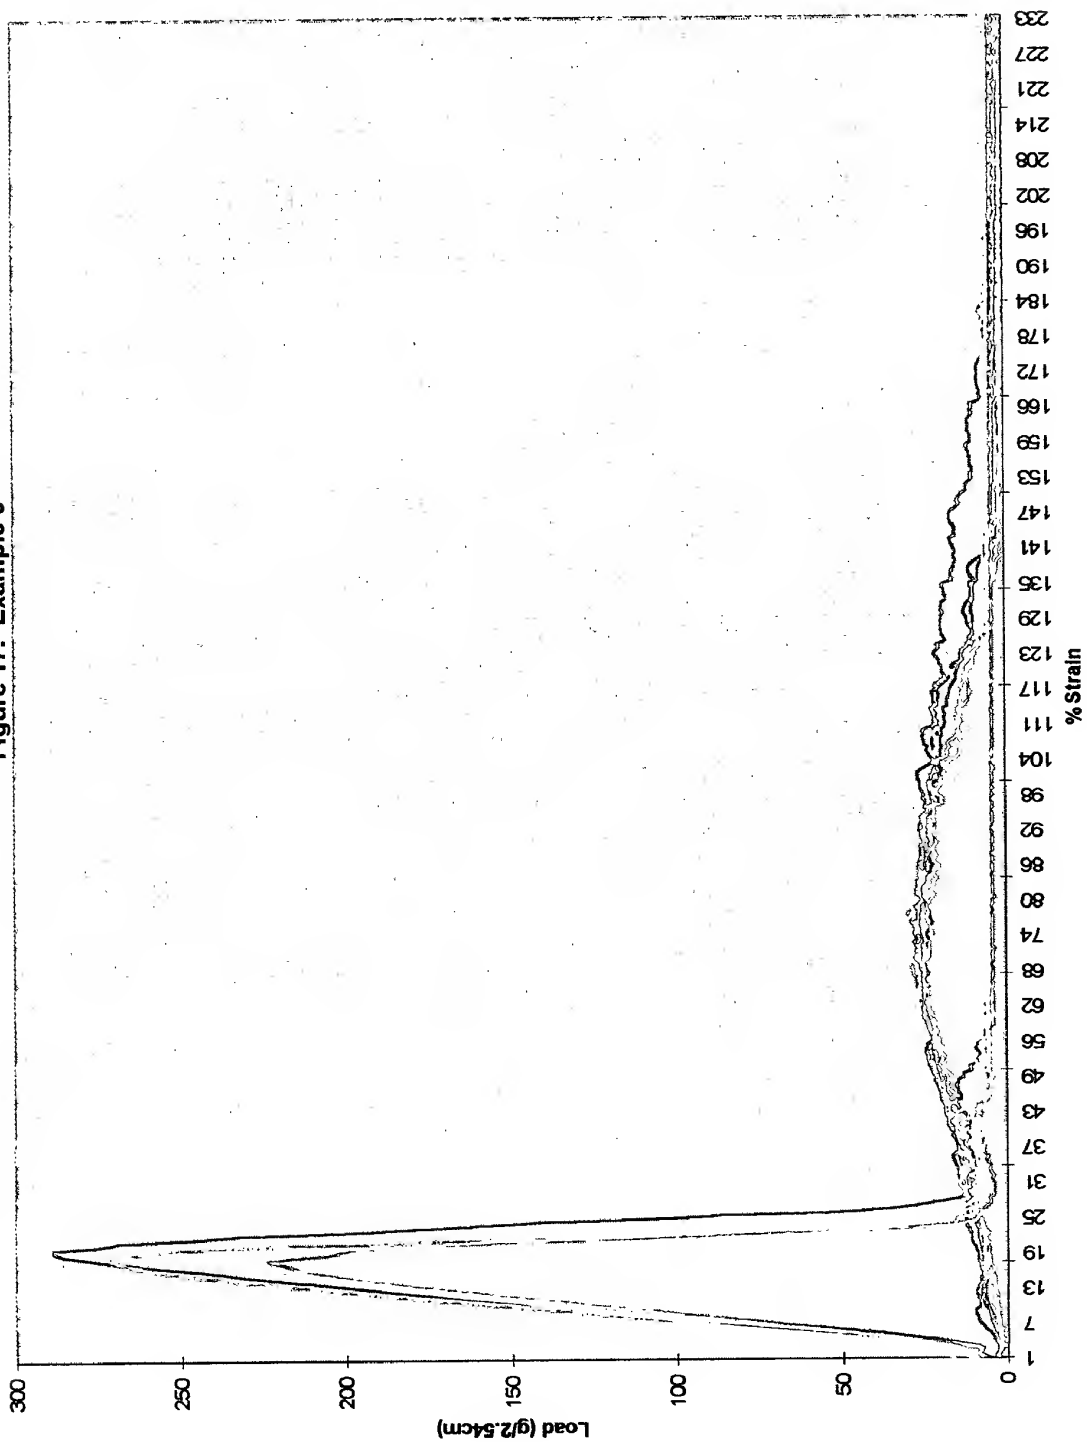


Figure 18. Example 6

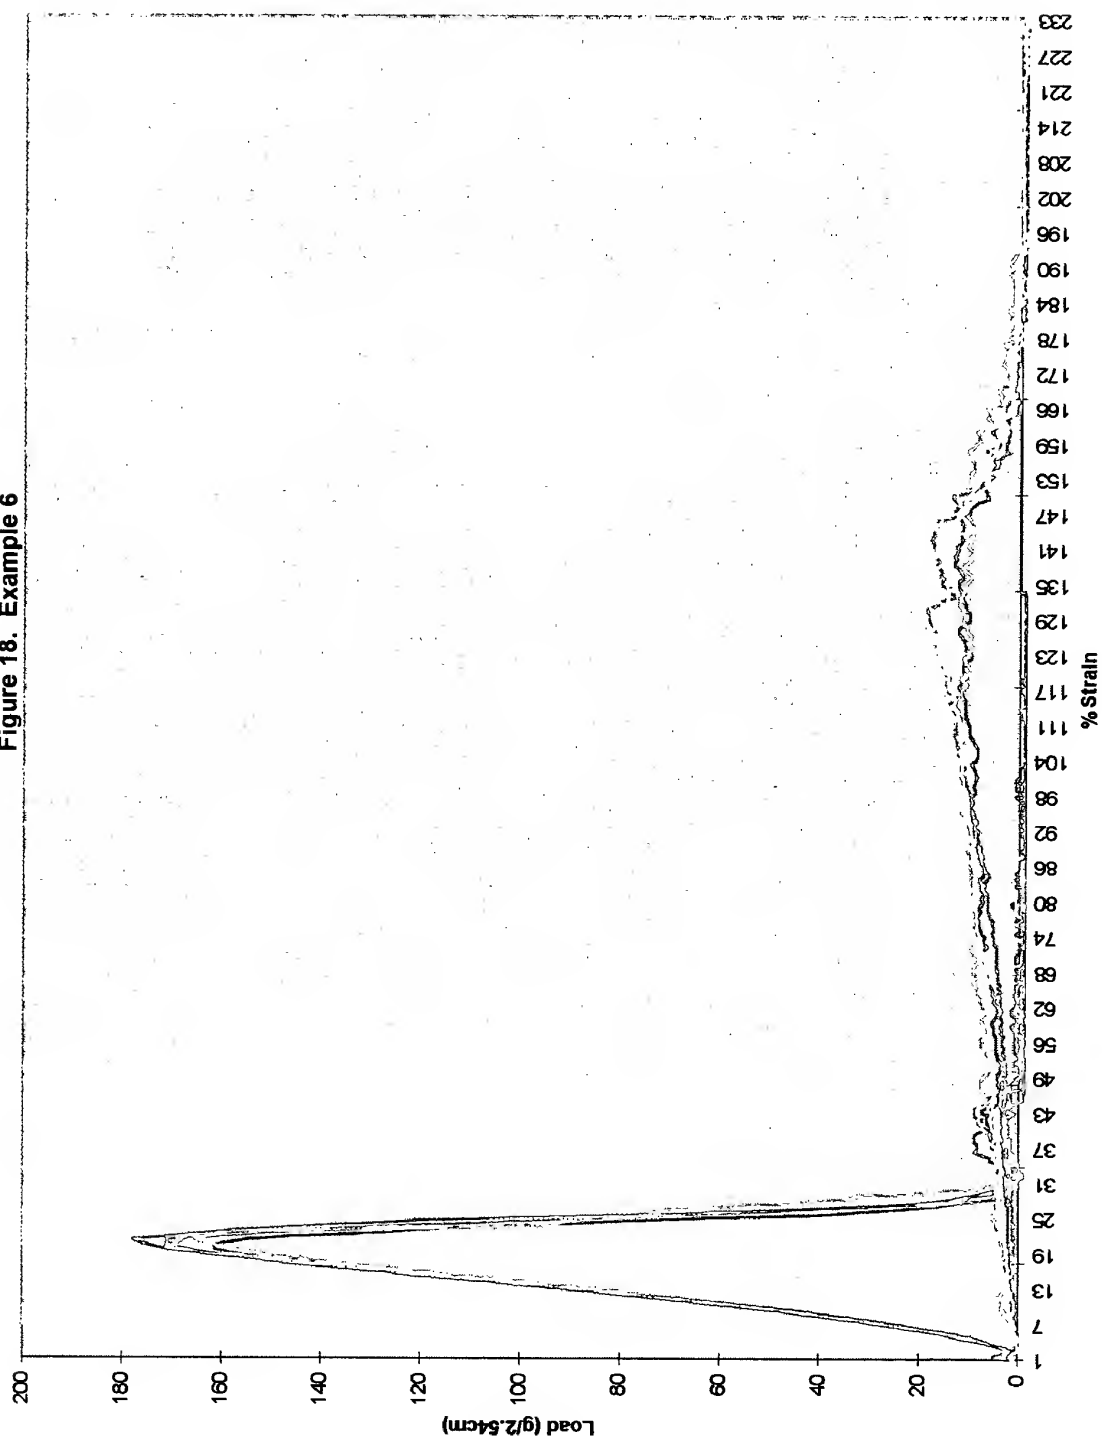

COLETT TEST 460

Fig. Example 1


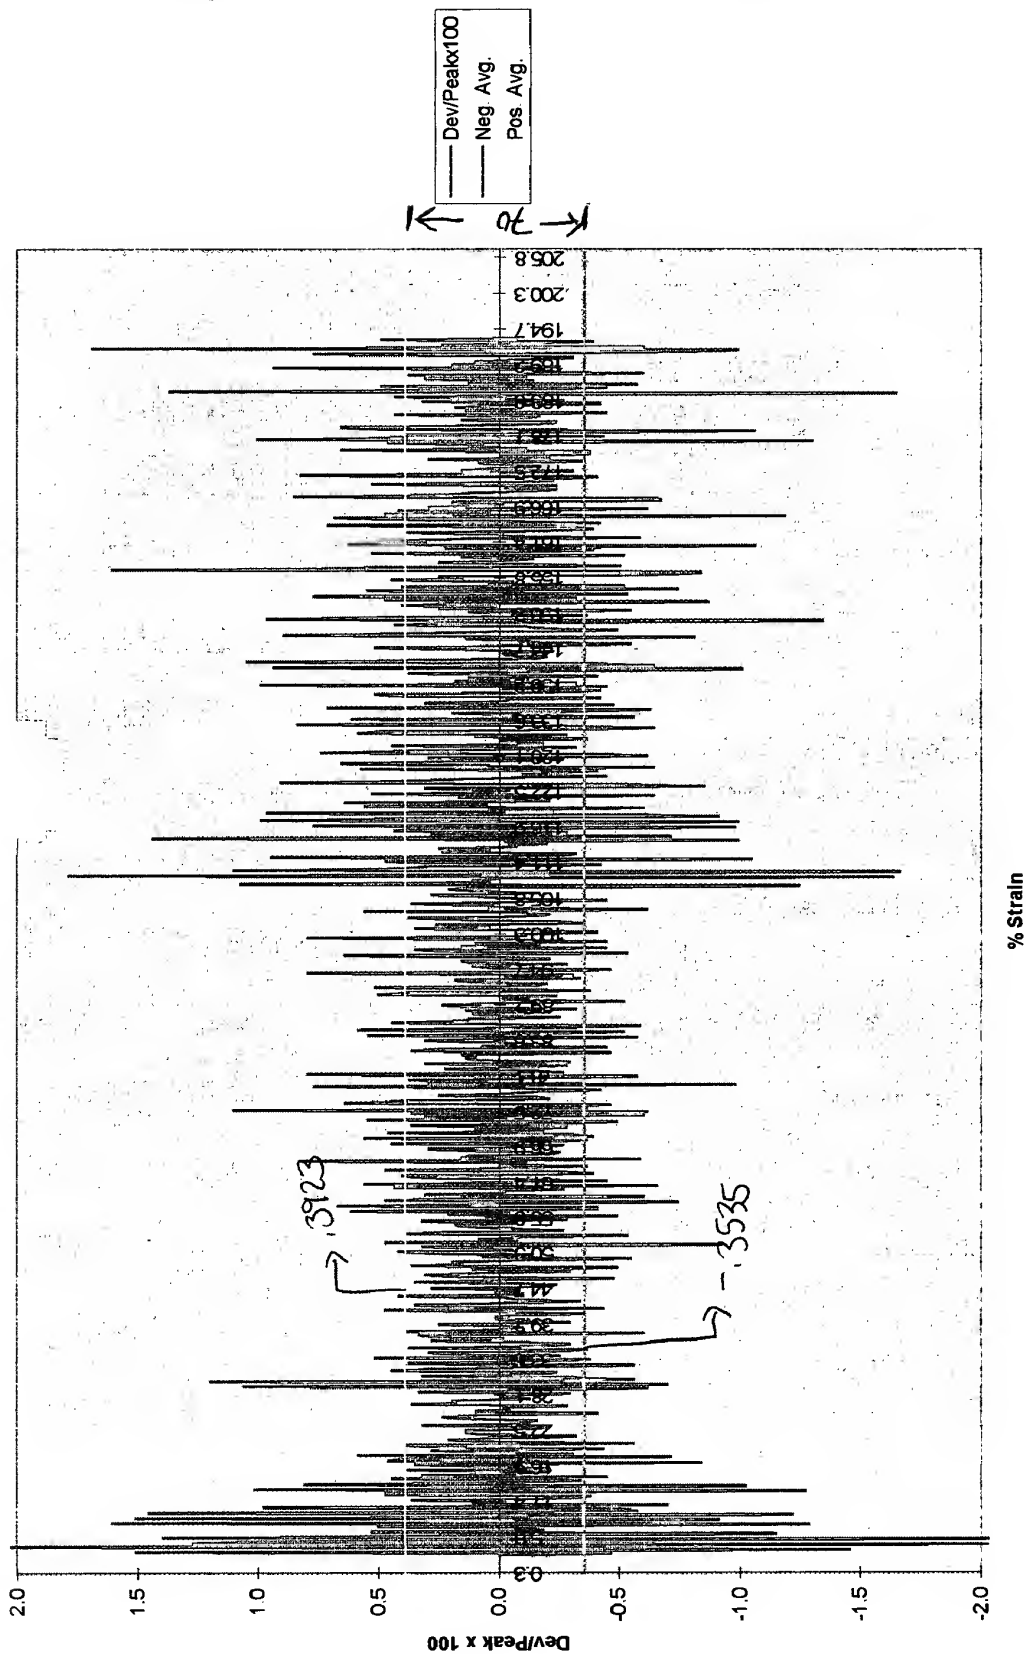


Fig 20. Example 2

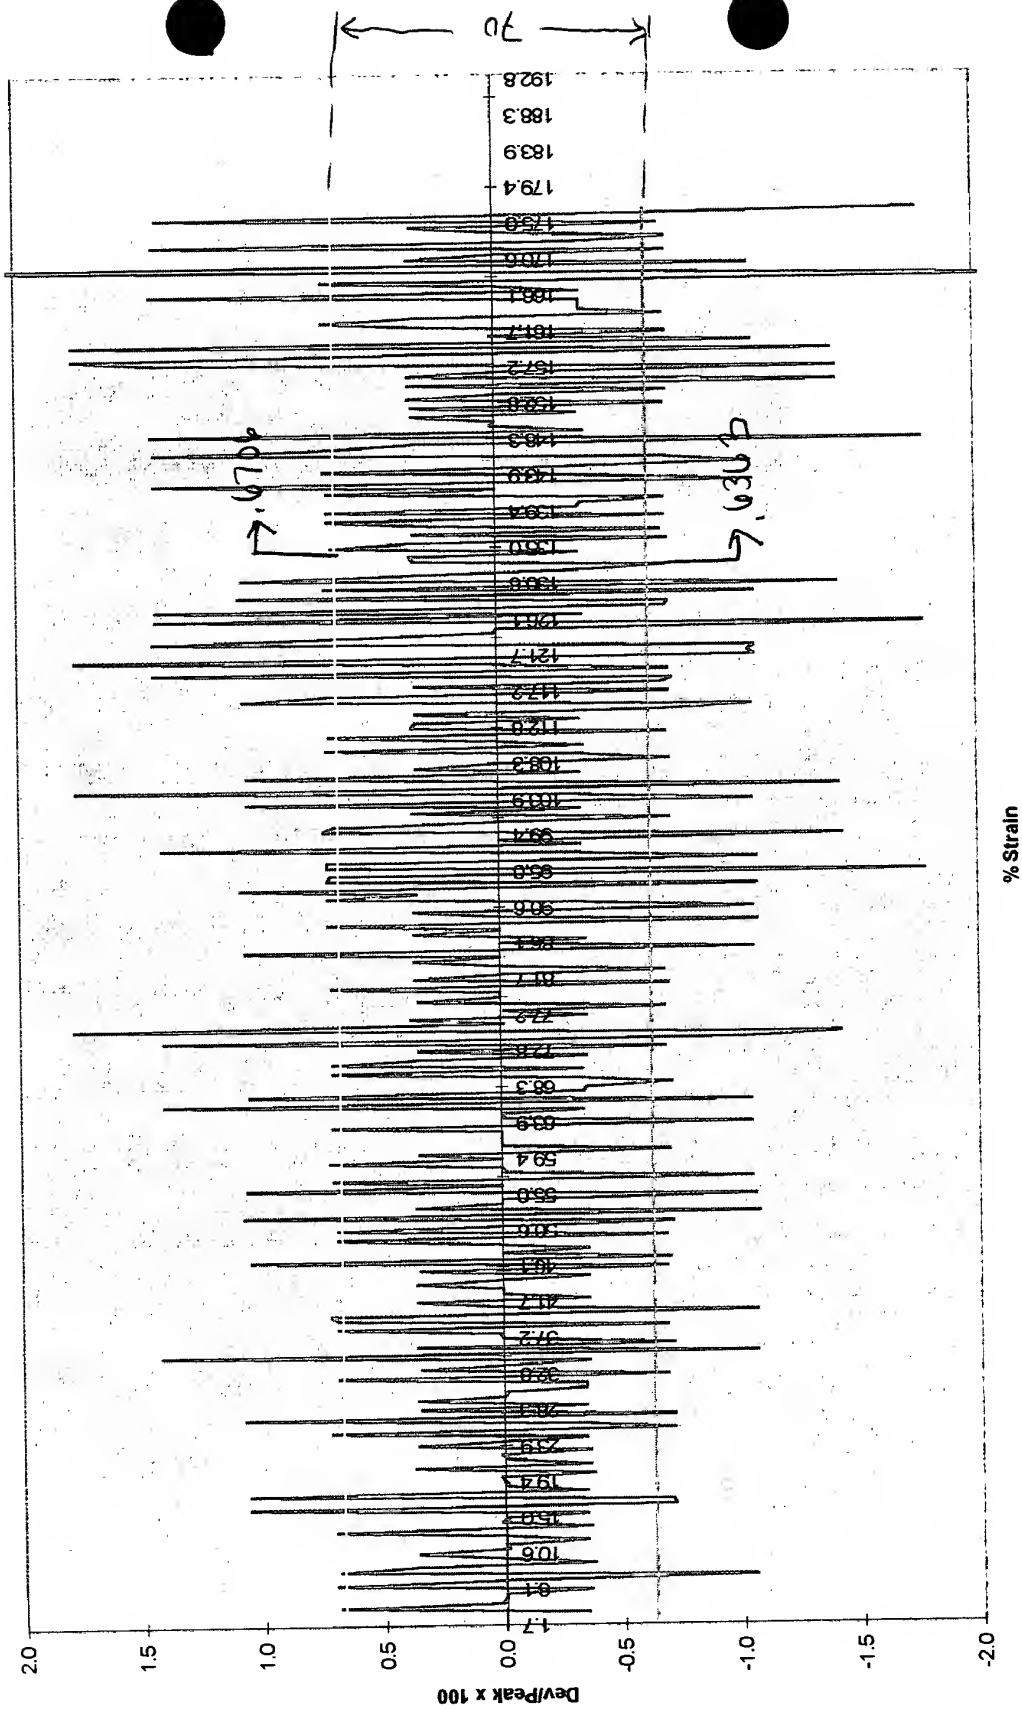

00477 "HESST 260

Fig 21 Example 3



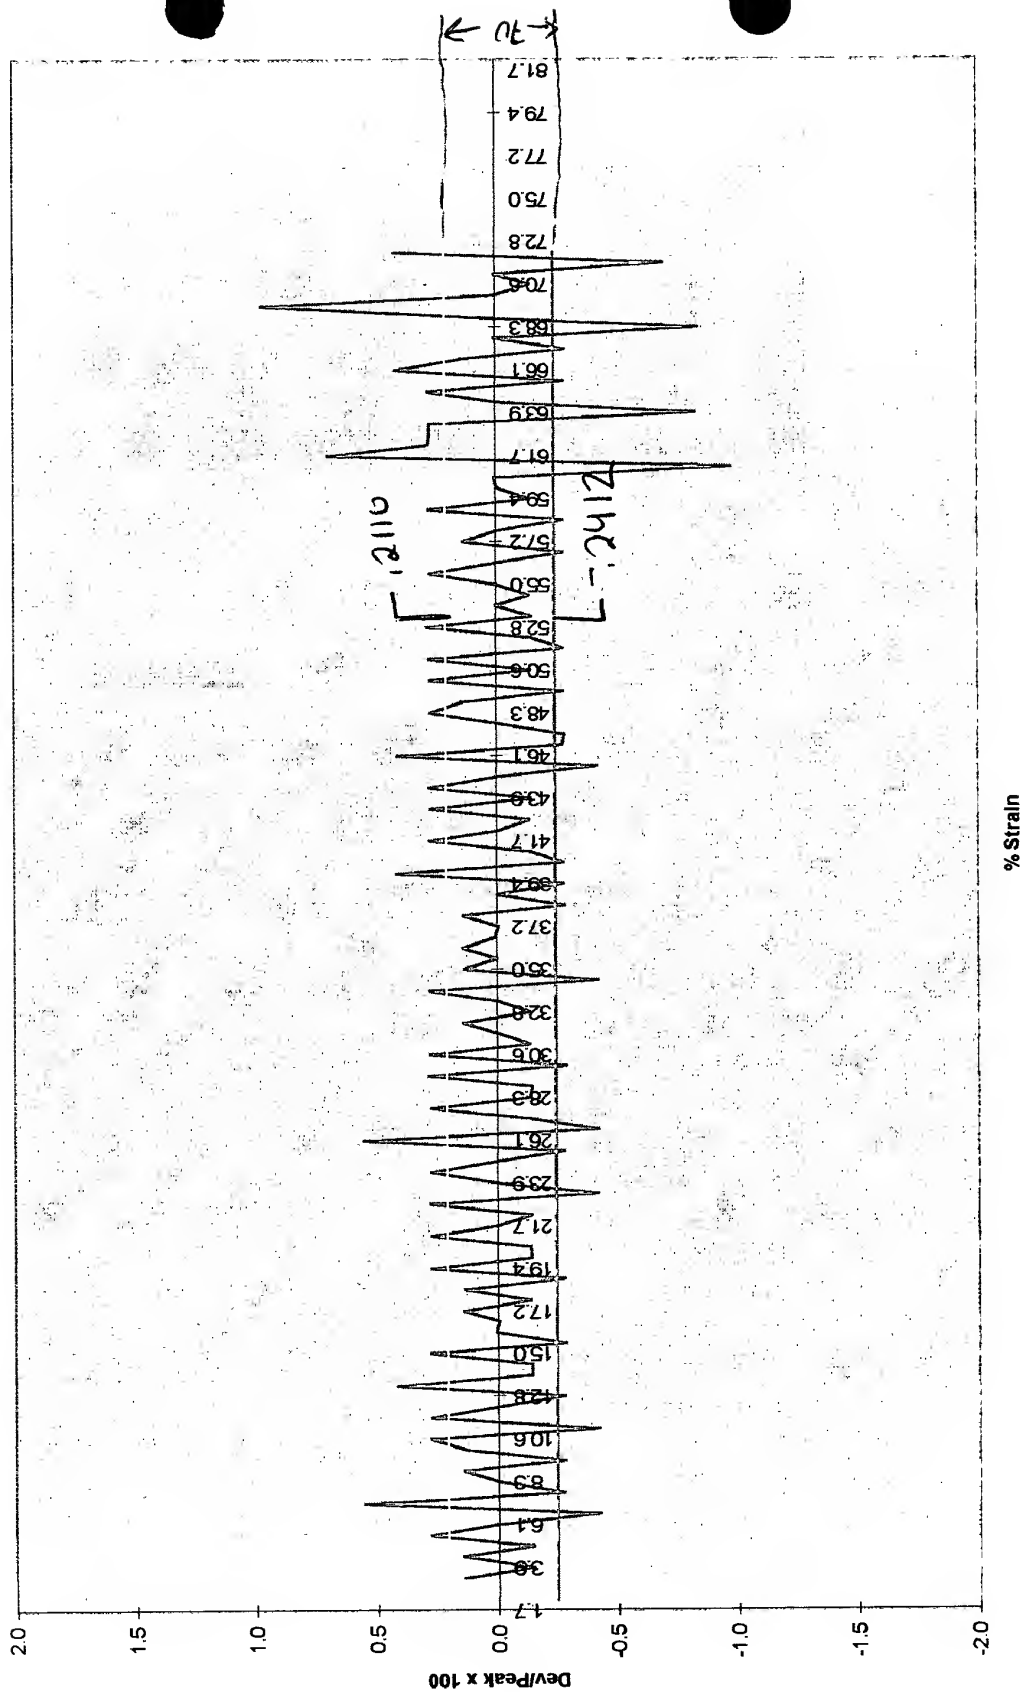


Fig. 22 Example 4

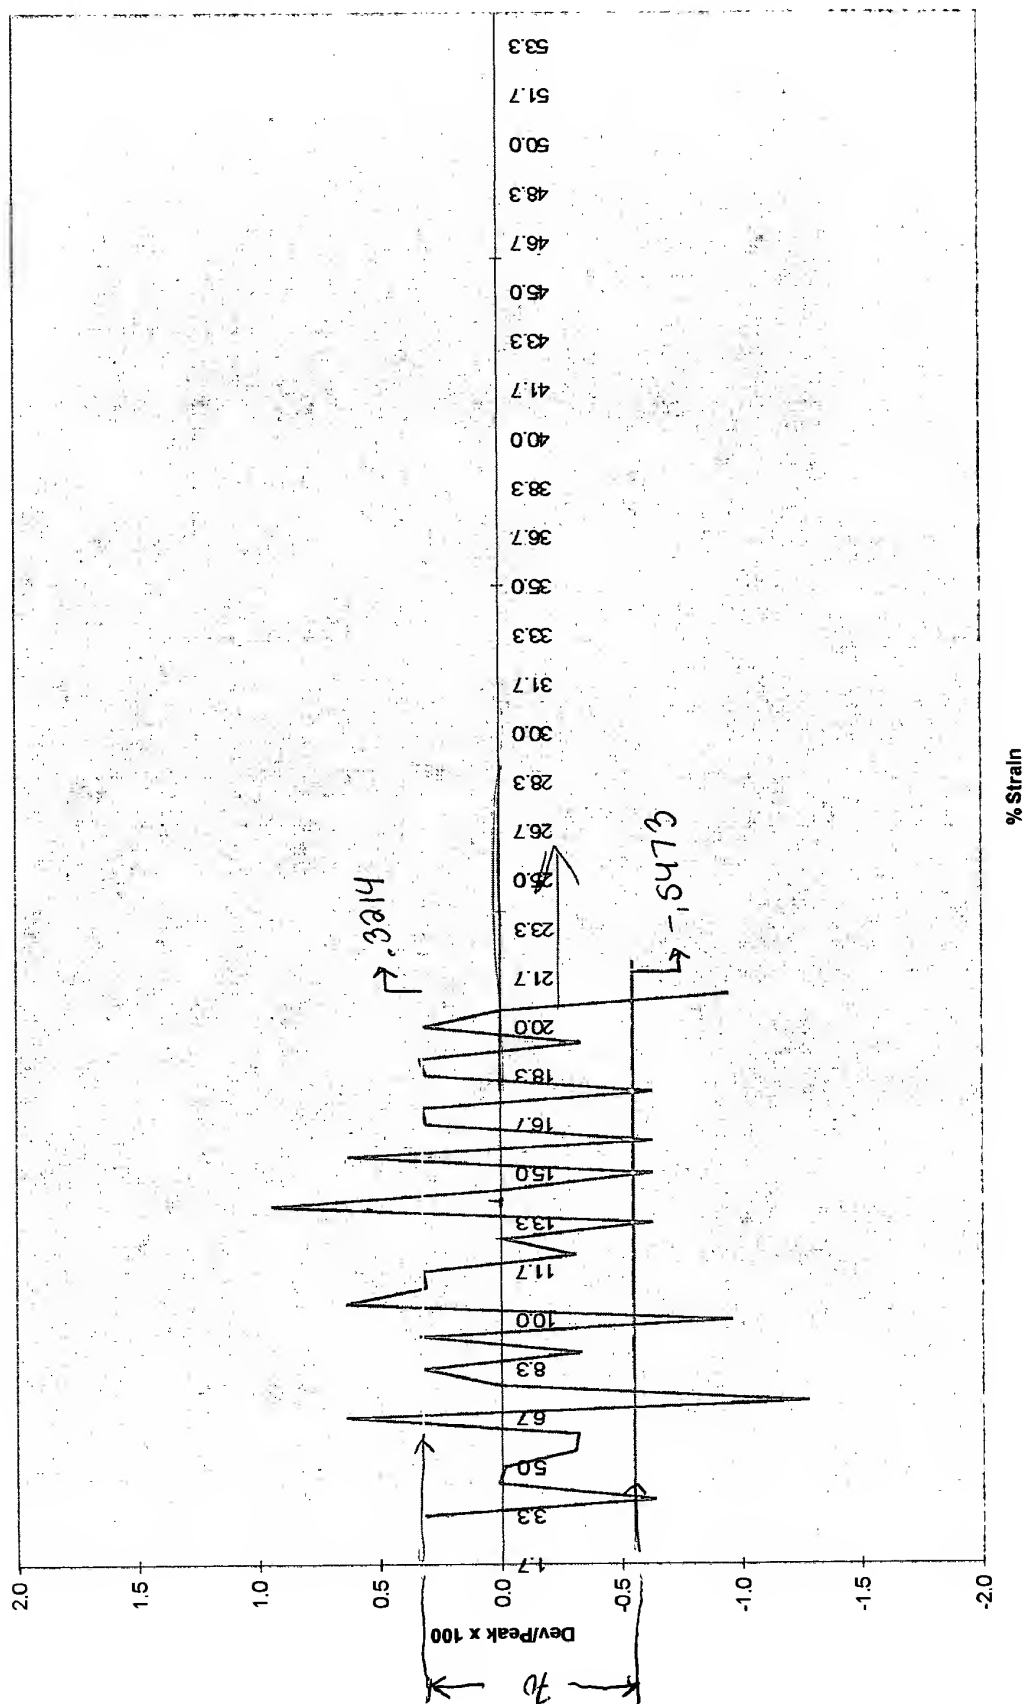

004114-4451260

Fig.23 Example 5

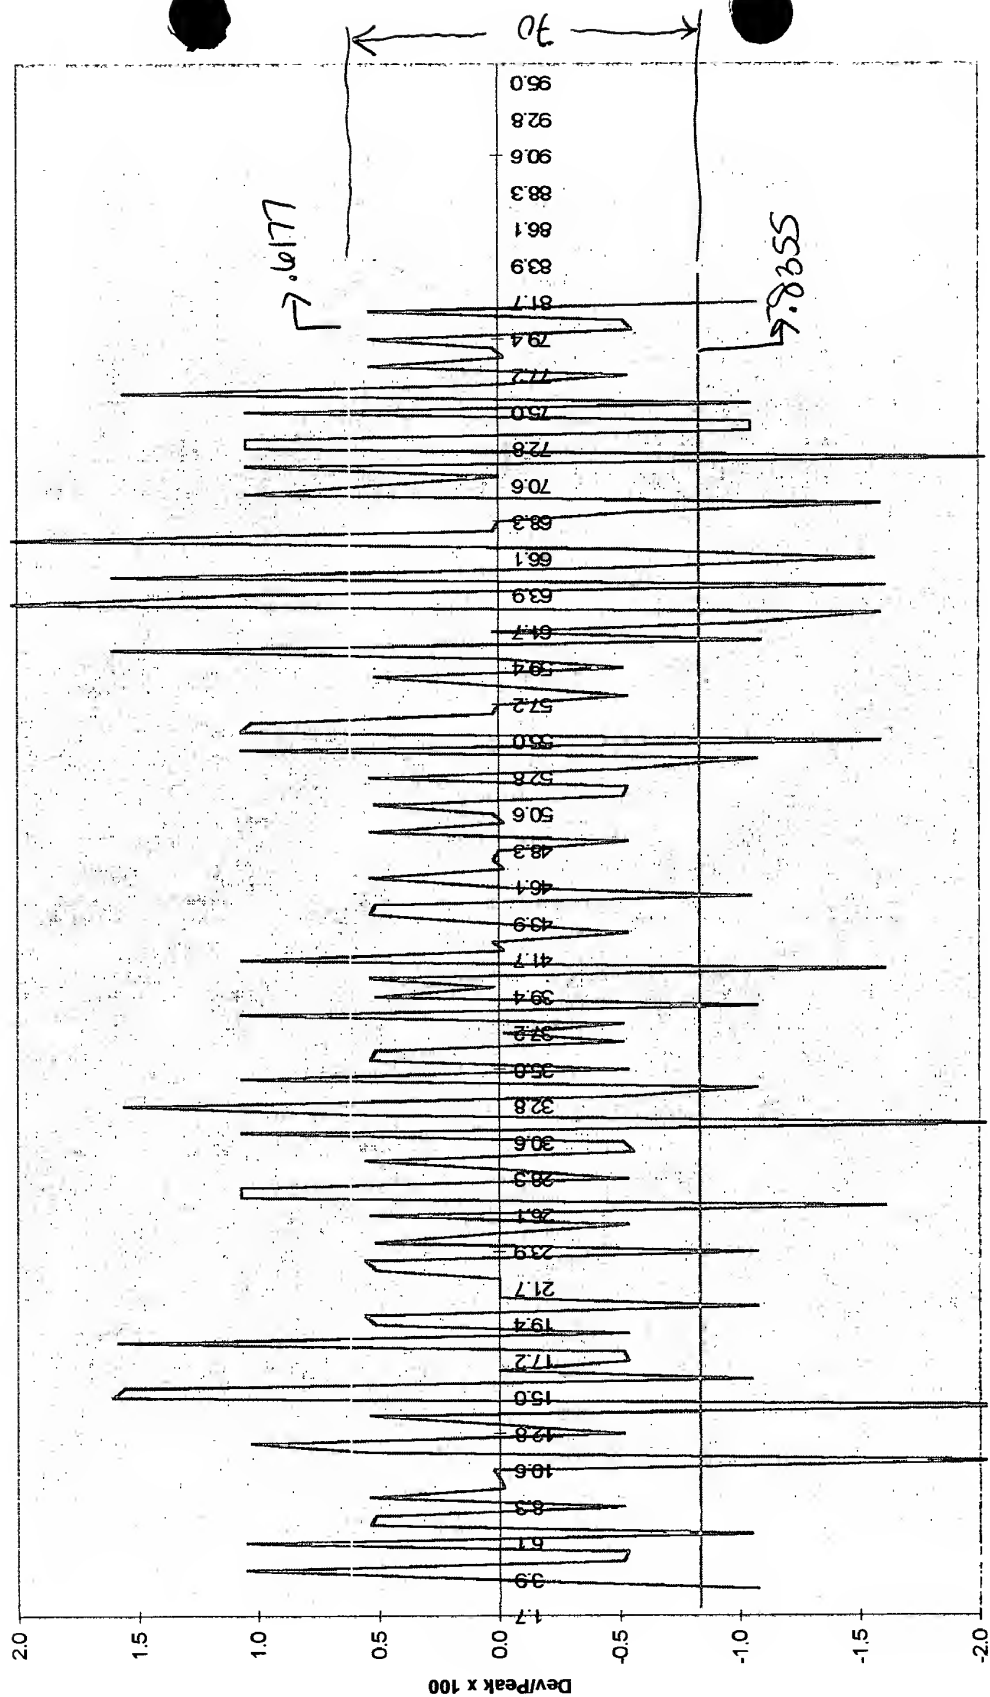

0041551660

Fig. 24 Example 6

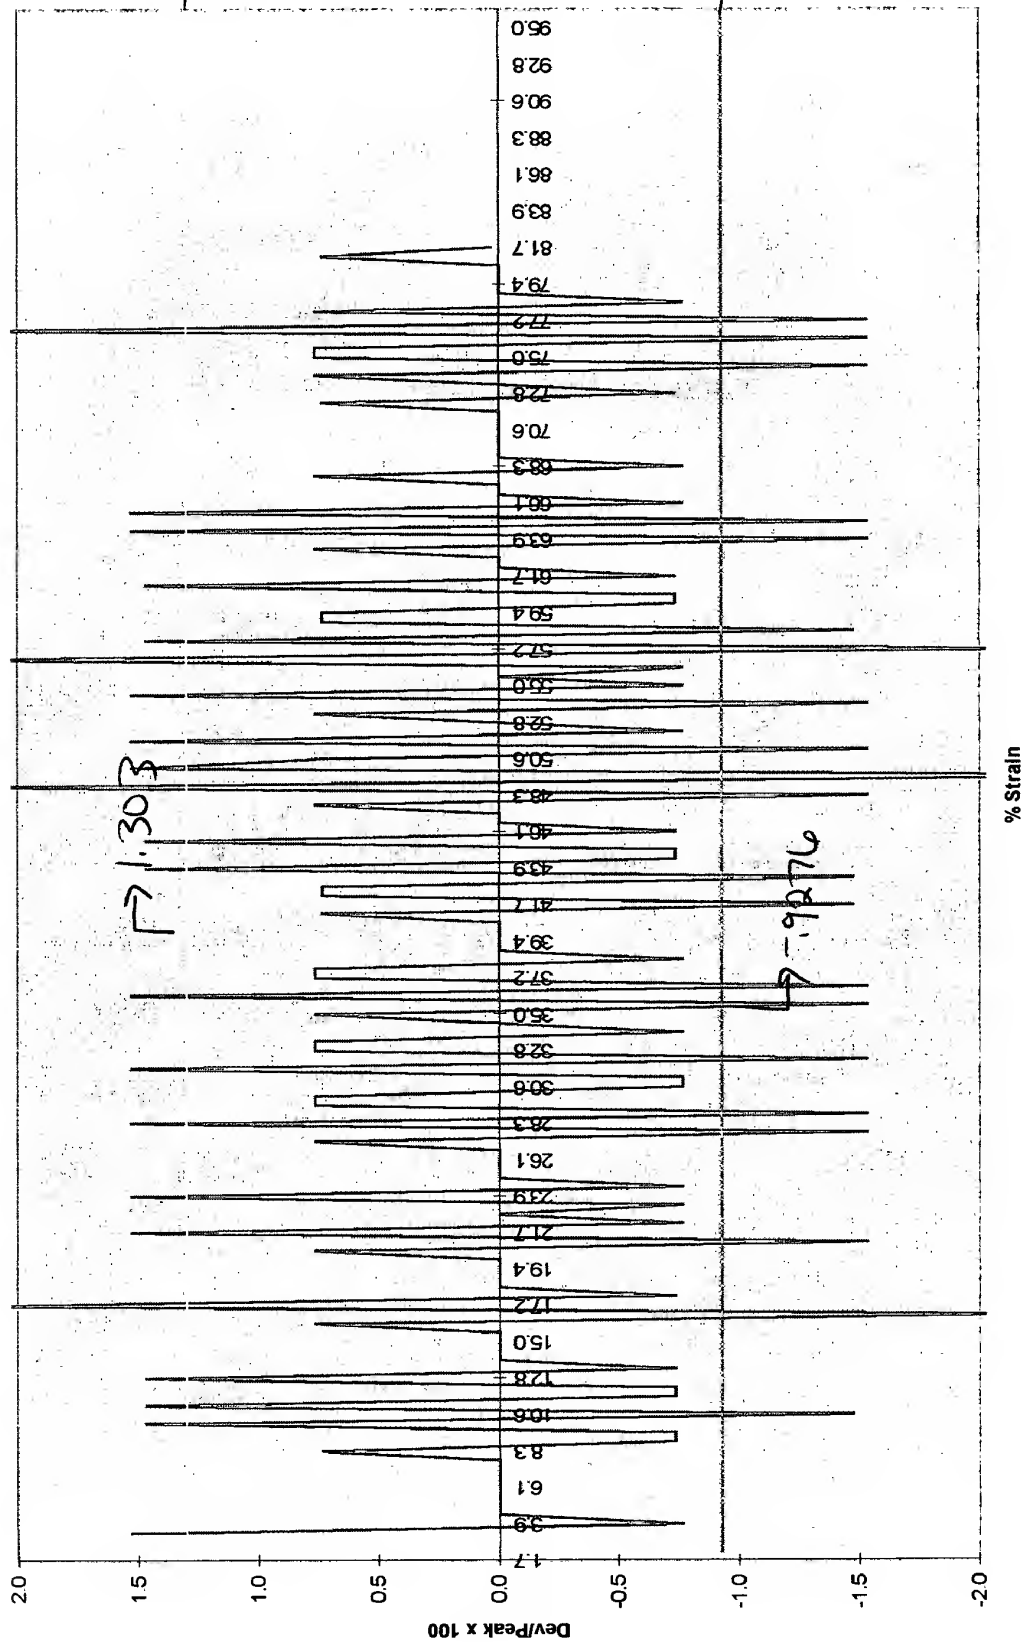


Figure 25


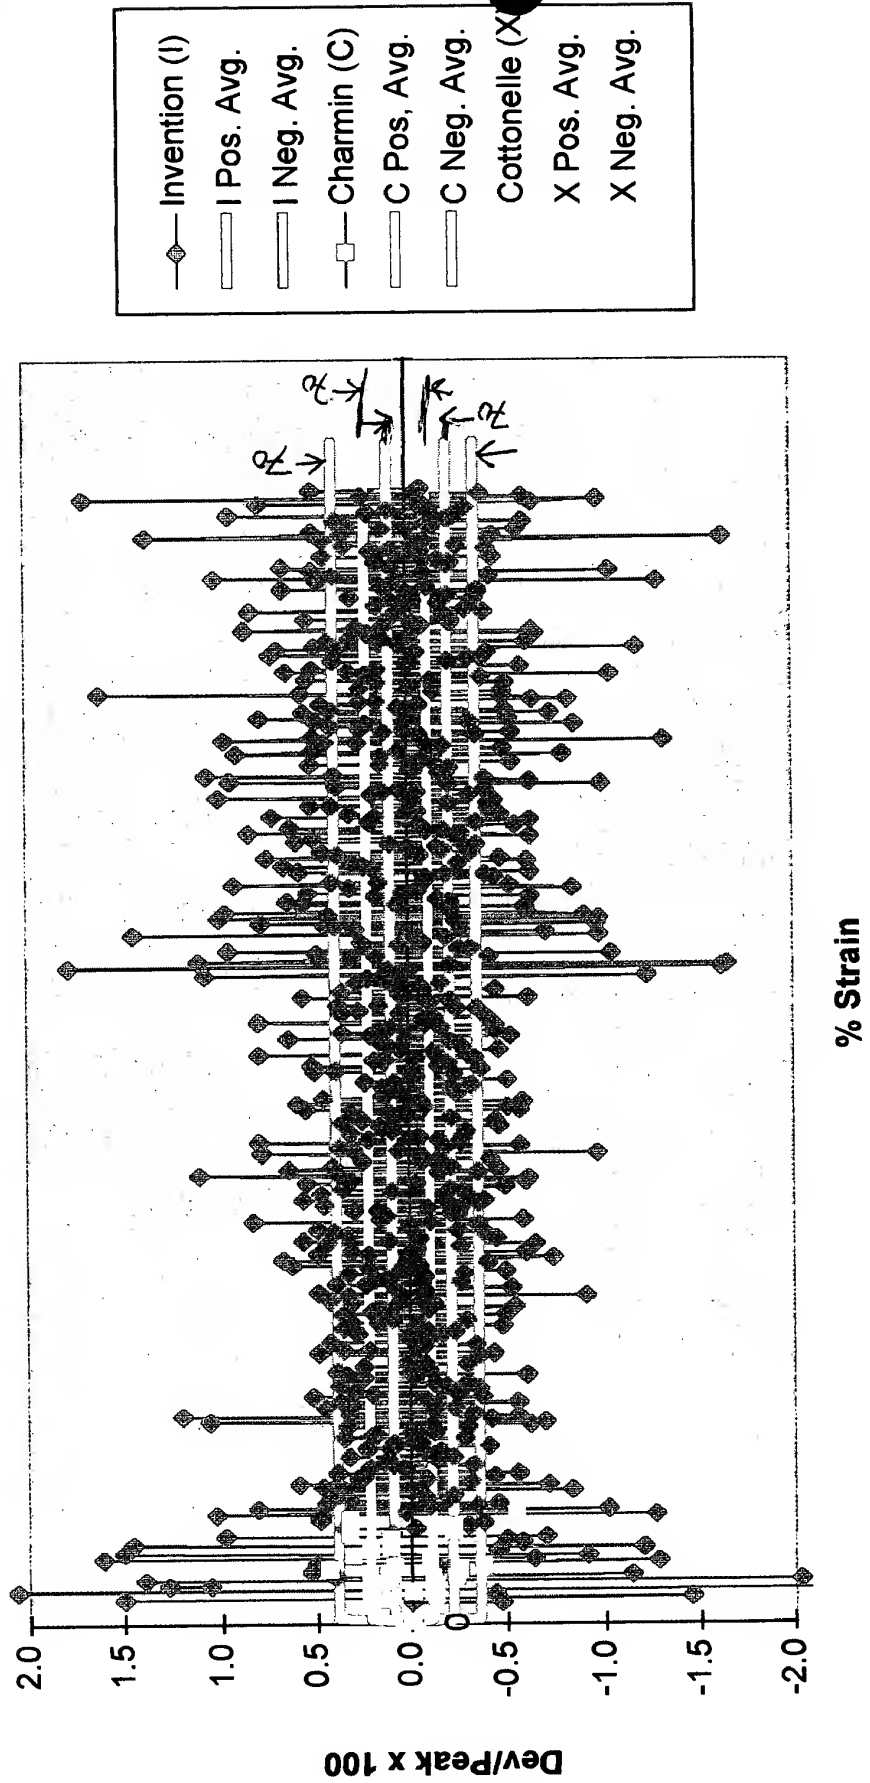


Figure 26

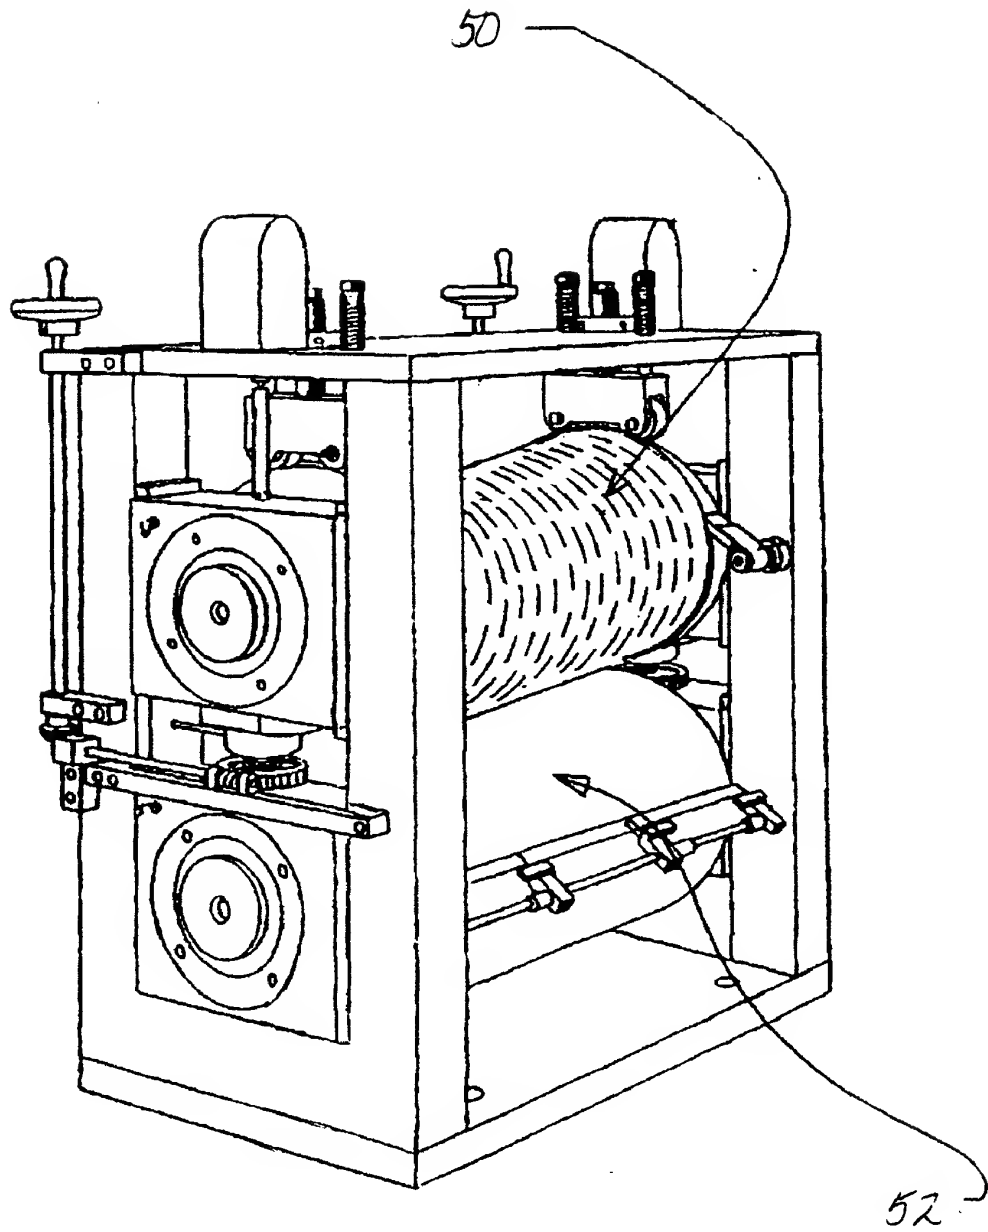

09715354-111700

Figure 27

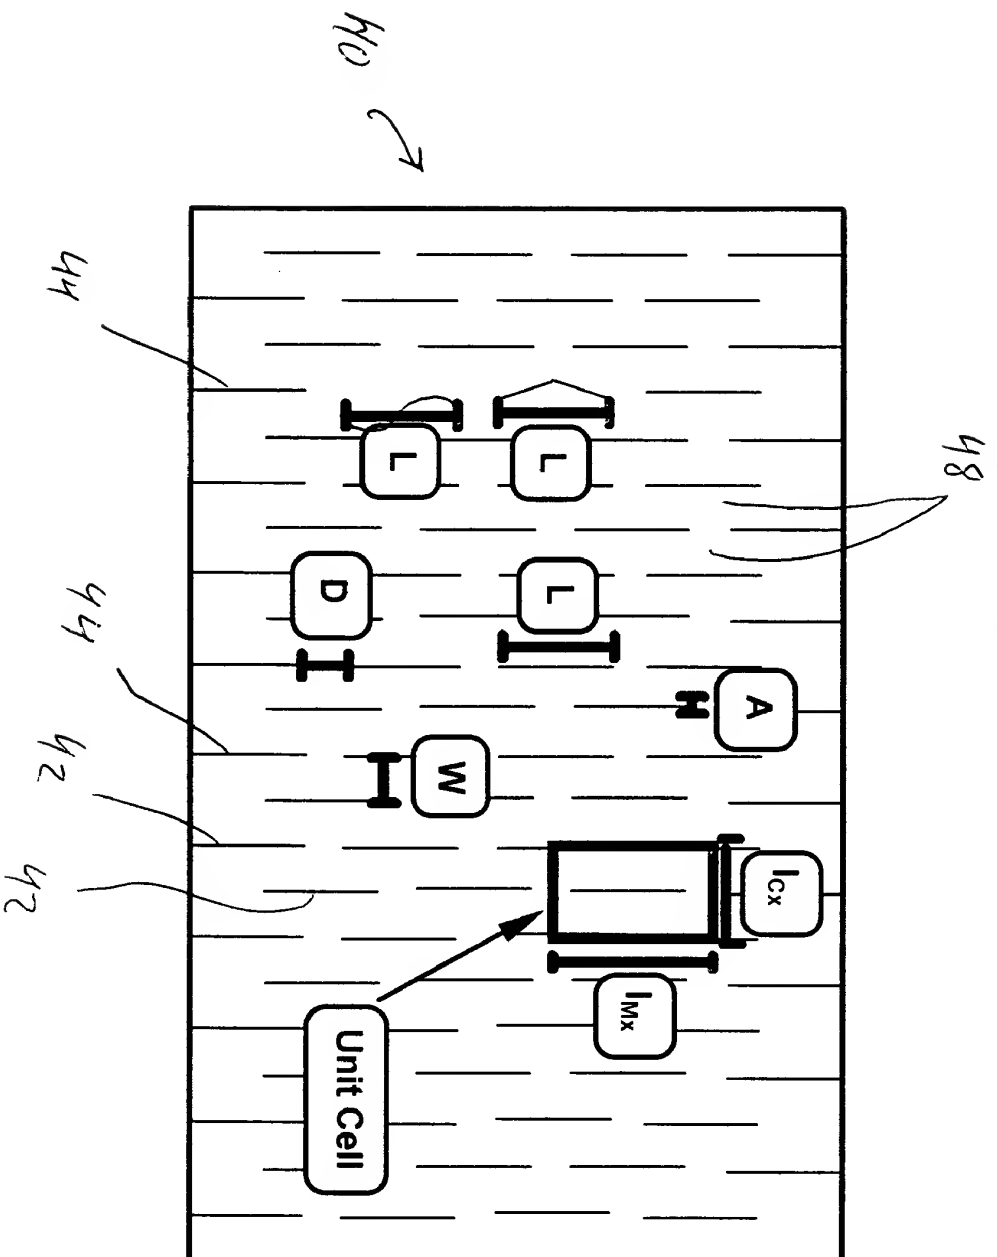


Figure 28

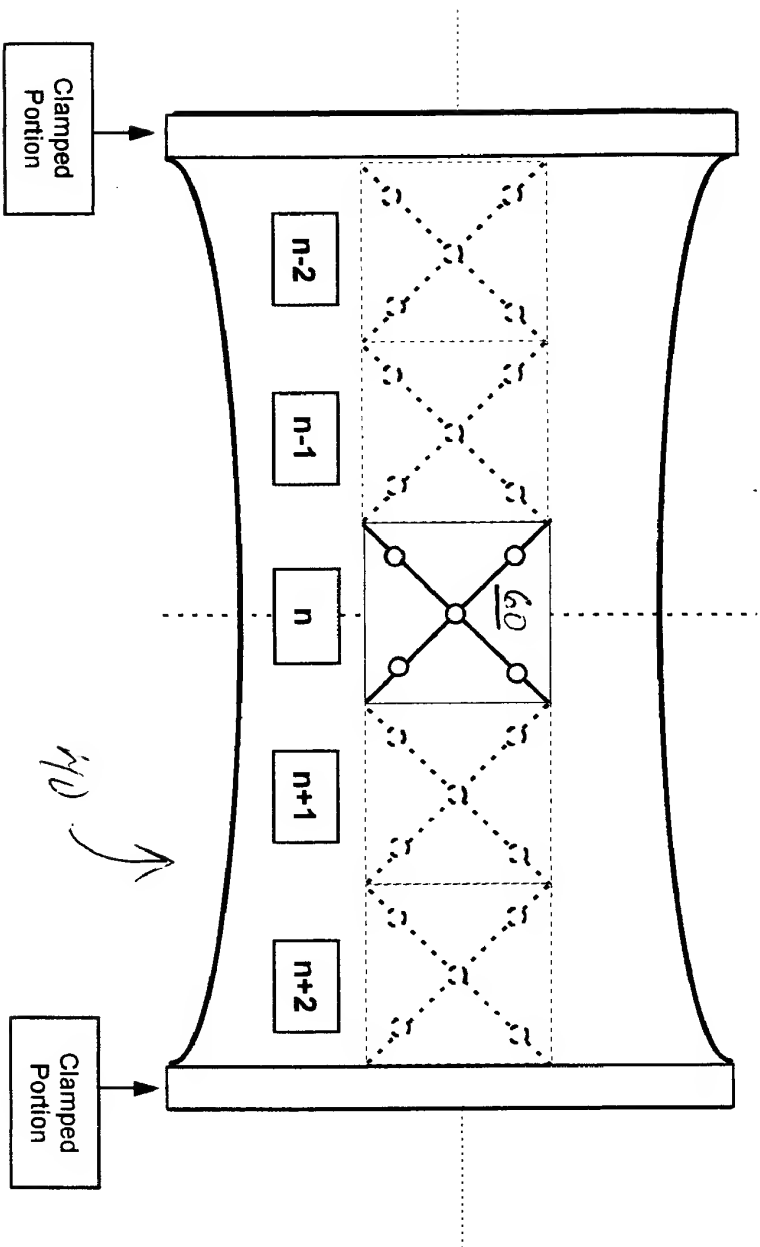


Figure 29a

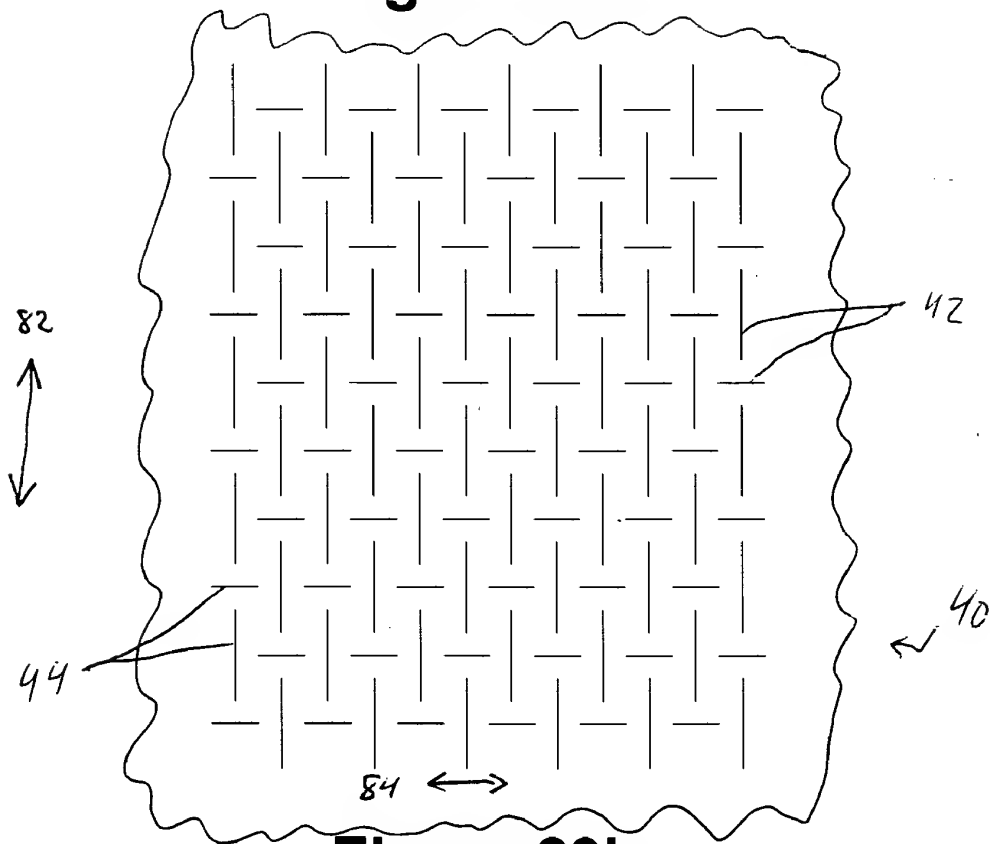


Figure 29b

